

WE CARE LIVES



BETA
industrial
PRODUCTS CATALOGUE

PRODUCT BULLETIN



Ver I May 2020





BETA
i n d u s t r i a l

index

>> FDF CURTAIN-TYPE FOR STATIC SYSTEMS	1 - 4
>> FDC/FDCA CURTAIN-TYPE FOR STATIC SYSTEMS	5 - 9
>> FDC/FDCA CURTAIN-TYPE FOR DYNAMIC SYSTEMS	10 - 14
>> BFD/BEFD MULTI-BLADES TYPE FOR STATIC SYSTEMS	15 - 24
>> BFD/BEFD MULTI-BLADES TYPE FOR DYNAMIC SYSTEMS	25 - 34
>> BMFSD/BEMFSD COMBINATION FIRE/SMOKE DAMPER	35 - 40
>> BMSD SMOKE DAMPER	41 - 46



FIRE DAMPER FOR STATIC SYSTEM - FDF MODEL - SINGLE SECTION

FEATURES :

- U.L. Classified for static systems in accordance with UL 555 & NFPA 90A.
- Civil Defense approved
- Fire rated for 1 1/2 hour.
- 100% Free area (Blades out of air stream)

CONSTRUCTION

- Casings: 1.2 mm thick manufactured from corrosion resistant galvanized mild steel.
- Blades: Roll formed single skin interlocking galvanized curtain shutter of 0.8 mm thk
- Blade guide / Locking ramps: Galvanized steel locking ramps ensures positive blade closure within integral blade guide.
- Fusible Link: Typical "two-pieces" fusible links rated at 165° F.
- Springs: Stainless steel coil tension spring.
- Mounting: Horizontal / Vertical
- (Installation as per instruction on page no 4)
- Sizes: Maximum Width 31" & Maximum Height 33" (Out to Out)
- Sleeves: are optional. details are as per pages 3 & 4

Casings

Manufactured from corrosion Resistant galvanized steel as standard

Blade guide / Locking ramps

Galvanized steel locking ramps ensures positive blade closure within integral blade guides.

Springs

Stainless steel coil tension spring ensuring powerful blade closure when appropriate

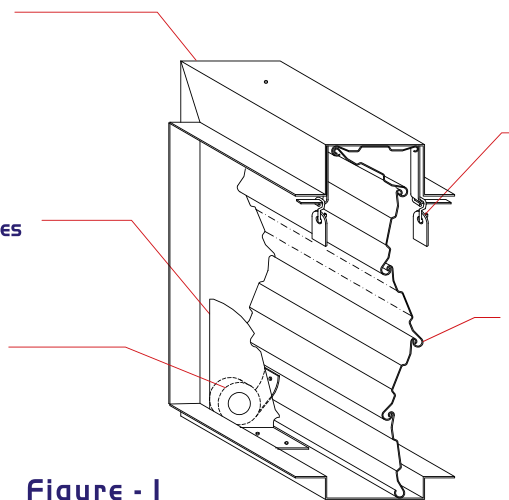


Figure - 1

Fusible links / release mechanism

Typical "two-pieces" fusible links rated at 165° F

Alternative temperature rated fusible links mechanisms available

Blades

(Rollformed single skin interlocking galvanized high integrity curtain shutter of 0.8 mm thickness)



R21930



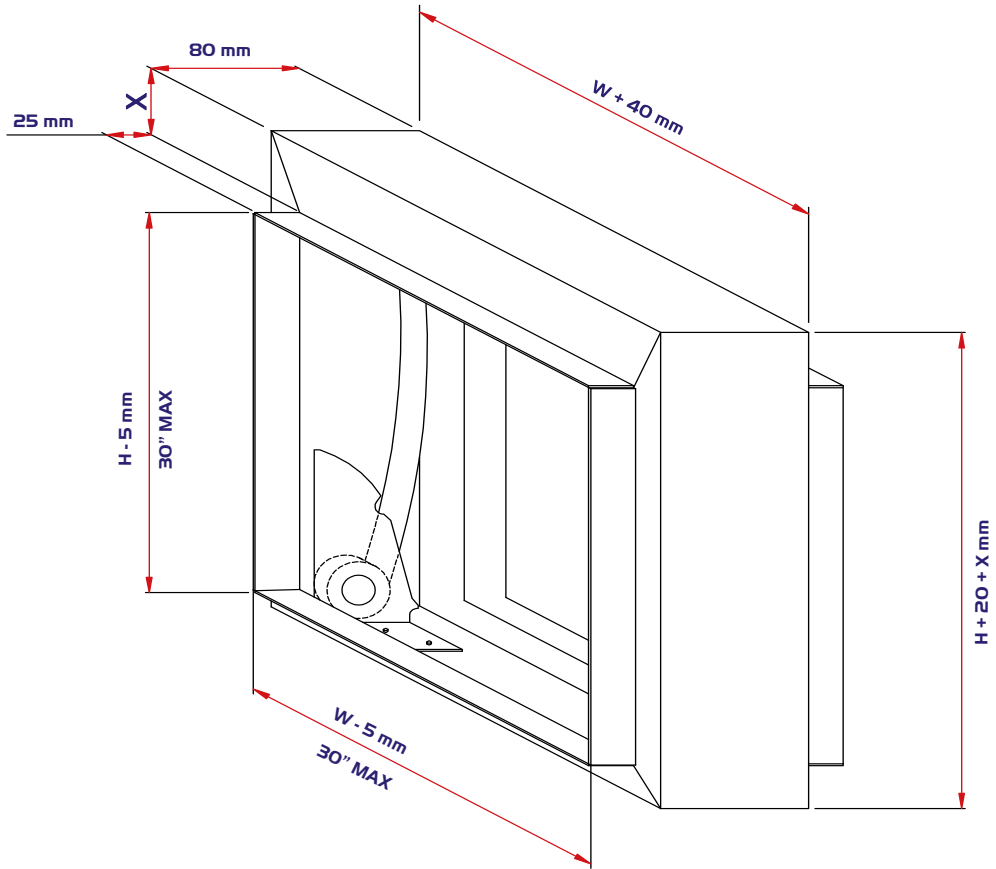


Figure - 2


X-DIMENSIONAL

FDF	
Height (mm)	X (mm)
100-400	40
401-750	60





CROSS SECTION DETAIL

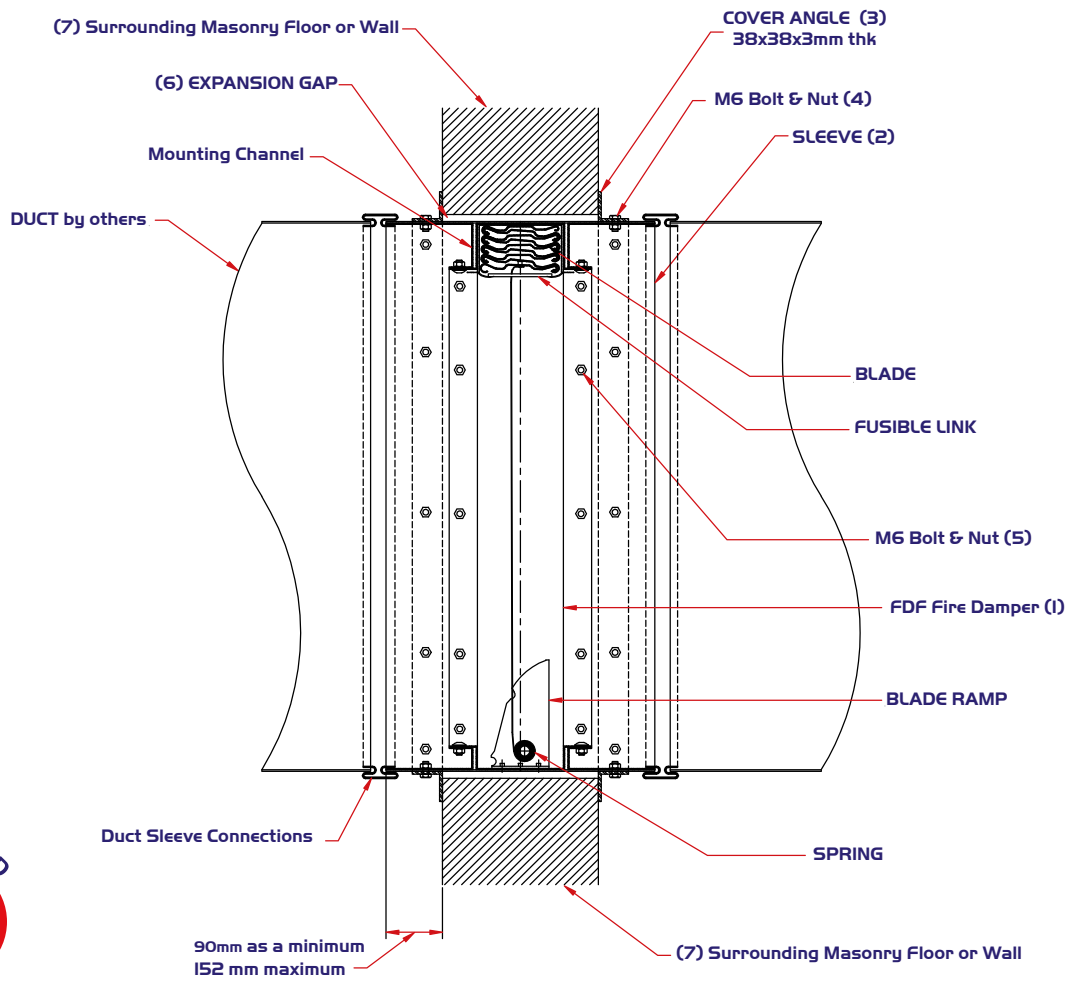

R21930

Figure - 3

Ordering Key:



F	D	F	W	X	H	S	L	V	F	1	2
100% FREE AREA FIRE DAMPER FOR VERTICAL & HORIZONTAL MOUNTING FOR STATIC APPLICATIONS											
SIZE: WIDTH X HEIGHT UP TO 31"X33" OUT-TO-OUT DIMENSIONS.											
- : WITHOUT SLEEVE (STANDARD)											
SLVF12 : WITH 1.2MM THICK G.I. SLEEVE											





INSTALLATION & OPERATING INSTRUCTIONS

- 1 >> The damper ① should be installed centrally within the surrounding masonry floor or wall ⑦
- 2 >> The damper ① should be installed in a rectangular galvanized steel sleeve ② with a min. thickness of 1.2 mm This sleeve should be attached to the damper not to the builder's work using the mounting channels by 6mm dia ⑤ bolts spaced at not more than 225mm centres. Bolts for mounting channels located maximum 45 and 145mm from corners of sleeve and frame, respectively.
- 3 >> The damper is suitable only for rectangular space and can not be used for annular space.
- 4 >> Allowance for expansion between sleeve and builder's work in both horizontal and vertical planes to be 3mm per 305mm of length.
- 5 >> The sleeve ② should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm and maximum of 152mm beyond the floor or wall.
- 6 >> The cover angles should be attached to the sleeve by 6mm dia ④ bolts at a minimum of 225mm centres, and should form a complete frame around the sleeve and cover over the expansion gap ⑥ required between sleeve and wall opening. The four corner of the cover angles are not to be welded.
- The bolts connecting the cover angles to the sleeve to be 102mm maximum from the corners.
- 7 >> The expansion gap ⑥ should be filled with compressible, non-combustible material (mineral wool).
- 8 >> The cover angle ③ should be of such a size as always to form a cover over the wall opening by 25mm minimum and should be manufactured from a minimum size of 38*38*3mm steel angle.
- 9 >> A fusible link UL tested Elsie brand which is rated at 165 degree F is used.
- 10 >> The duct-sleeve connection to be of double "S" slip type.
- Breakaway Joints shown shall have no more than two No. 10 (4.8 mm dia) sheet metal screws on each side and on the bottom located in the center of the slip pocket and shall penetrate both sides of the slip pocket.
- Breakaway Joints for horizontal ducts (vertical fire damper) shall be provided on the top, bottom and on the sides with double "S" slip type as illustrated.
- Breakaway Joints for vertical ducts (horizontal fire damper) shall be provided on both other opposite sides with double "S" slip type.
- Connecting ducts shall not be continued and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 11 >> All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.






FIRE DAMPER FOR STATIC SYSTEMS - FDC/FDCA MODELS

SINGLE SECTION

FDC 100% FREE AREA



FDCA NOT 100% FREE AREA

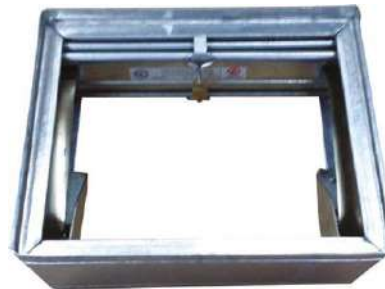

MULTIPLE SECTION

FDCA NOT 100% FREE AREA





FIRE DAMPER FOR STATIC SYSTEMS - FDC/FDCA MODELS

FEATURES:

- UL classified for static systems in accordance with UL 555 & NFPA 90A
- Civil Defence Approved
- Fusible link set at 165° F
- Fire rated for 1 1/2 hour
- Mounting type: vertical

MAXIMUM UL CLASSIFIED SIZES (OUT TO OUT)		
section	MAXIMUM WIDTH (")	MAXIMUM HEIGHT (")
SINGLE	36	36
MULTIPLE	72	72

CONSTRUCTION

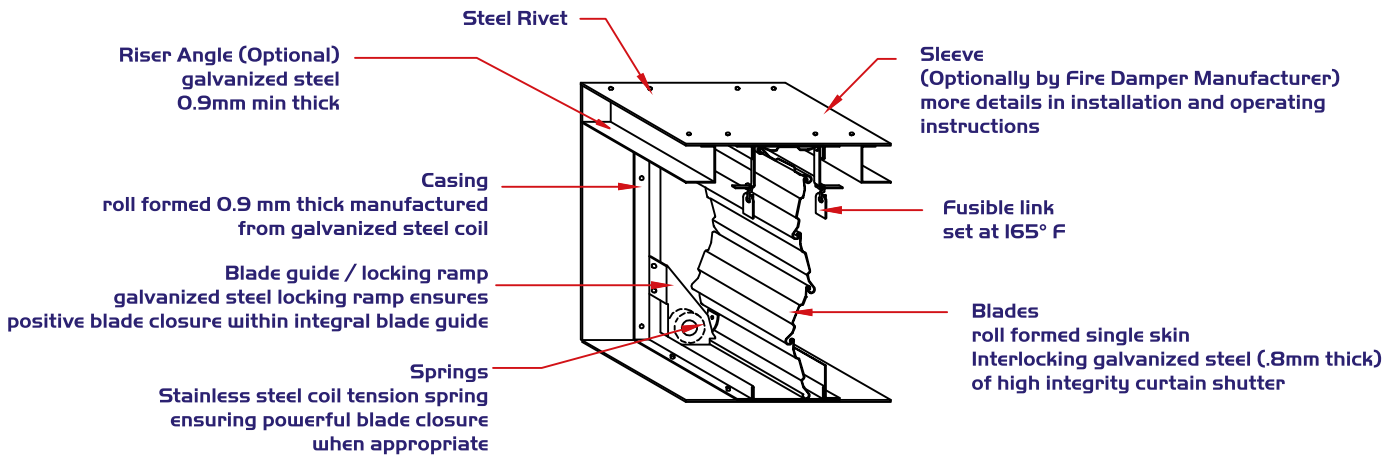


Figure - 1

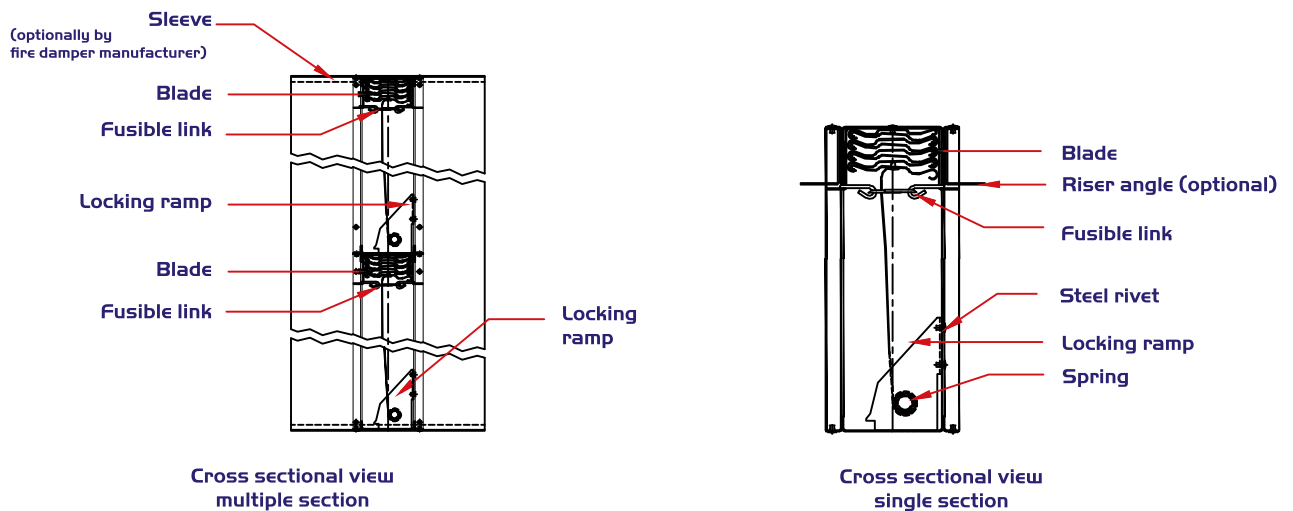


Figure - 2





INSTALLATION AND OPERATING INSTRUCTIONS

1. The damper (1) should be installed centrally within the surrounding masonry / gypsum floor or wall (7)
2. The damper (1) should be installed in a rectangular galvanized steel sleeve (2) (optionally by Fire Damper Manufacturer) with a minimum thickness of 0.9mm. This sleeve should be attached to the damper not to the builder's work using steel rivets (5) 4.8mm dia and spaced at not more than 225mm centers and 13 mm from corners (1/2")
3. The damper is suitable only for rectangular space and can not be use for annular space.
4. Allowance for expansion between sleeve and builder's work in both horizontal and vertical planes to be 3mm per 305 mm of length and width.
5. The sleeve (2) (optionally Fire Damper Manufacturer) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork.
Minimum of 90 mm and maximum 152 mm beyond the floor or wall / include thicknesses of sleeve in table I.
6. The mounting angles (3) should be attached to the sleeve (optionally by Fire Damper Manufacturer) by 8mm dia (4) bolts at a maximum of 225 mm centers, and should form a complete frame around the sleeve and cover over the expansion gap (6) required between sleeve and wall / floor opening. The four corner of the mounting angles are not to be welded. The bolts connecting the mounting angles to the sleeve to be 102 mm maximum from the corners. Mounting angles will be send in loose parts.
7. The mounting angles (3) should be of such a size as always to form an overlap with the wall / floor by 25 mm minimum and should be manufactured from a minimum size of 35 x 35 x 2.5mm GI angle.
8. A fusible link is UL tested, Elsie brand, set at 165° F
9. The duct - sleeve connection to be of as per what shown in (figure 5) page (8) connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A
10. All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

Sleeve Thickness (mm)
0.9
1.2
1.5
2

TABLE I


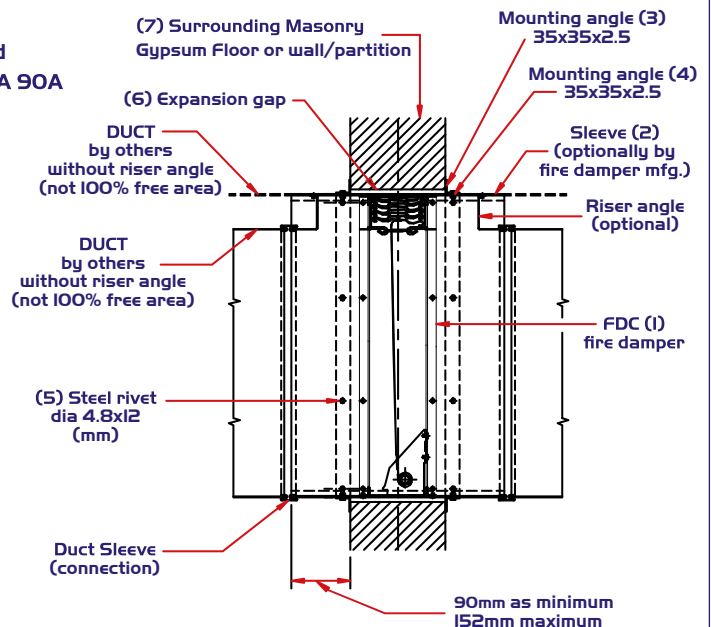


Figure 3 (CROSS SECTION DETAILS)
SINGLE SECTION FDC FIX TO WALL

11. In Multiple Section FD center cross section point which obtain from attaching four individual section are welded from two sides.
12. In multiple section FD, Individual section FD attached with each other by steel rivet 4.8mm dia., space between rivet more than 225 mm centers, and (1/2") 13 mm from the corners.
13. Multiple section FD is enclosed with a single rectangular galvanized steel sleeve (optionally by Fire Damper Manufacturer).
The fixing of the sleeve to the FD frame using steel rivet 4.8mm dia. Space not more than 225mm center to center and (1/2") 13 mm from corners. Sleeve (optionally by Fire Damper Manufacturer) thickness as per what mentioned on Table no. I
14. The maximum size of the multiple fire damper assembly that is assembled is 72" x 72".
15. In multiple section FD, The maximum size of the individual section that are attached together is 36" x 36".

Figure 4 (FRONT VIEW)
MULTIPLE SECTION FDCA WITH SLEEVE



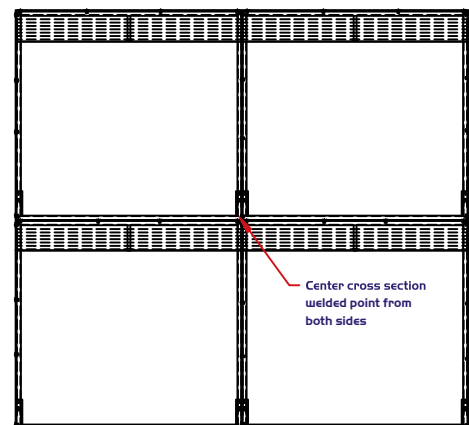

DUCT - SLEEVE CONNECTIONS

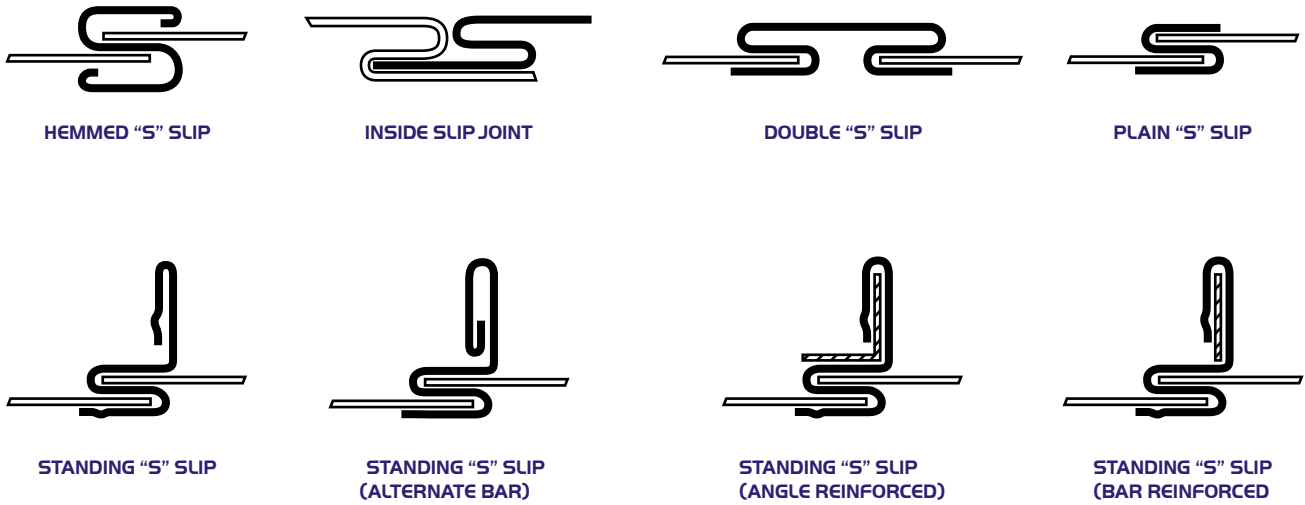


Figure - 5

EXPLODED ASSEMBLY FOR FDC TYPE WITH SLEEVE

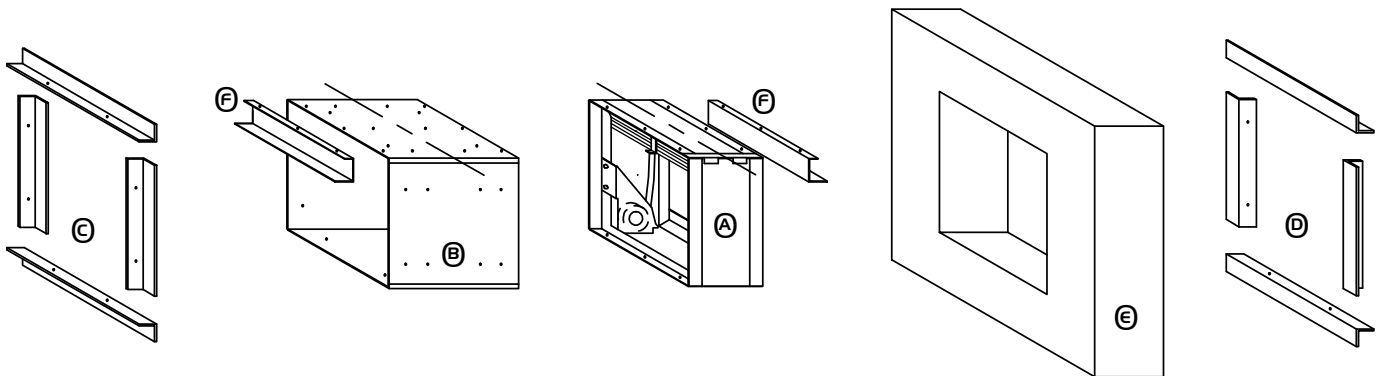


Figure - 6

ASSEMBLY PROCEDURES:

1. Fix the damper (A) into the sleeve (B) matching their center axis and hole provision using steel rivet.
2. If the riser angle (optional) is use then, fix the riser angle (C) (optional) into the fire damper sleeve matching their hole provision using steel rivet. If not go to step no.3.
3. Fix the fire damper with sleeve into the concrete / gypsum wall (E) opening by a front mounting angle (D) 35x35 matching their hole provision using M8 Hex bolt and nut. Opening size should have clearance of 3 mm per 305 mm of length and width.
4. Finally when the Fire Damper with sleeve is already fitted to the wall, fix the back mounting angle (D) 35 x 35 matching their hole provision using M8 Hex bolt and nut.





ORDERING SYSTEM

SINGLE SECTION

FDC 100% FREE AREA

SIZES RANGE

	(mm)	(inches)	X (mm)	H (mm)
H	80 - 825	3.2" - 32.5"	25	80 - 150
W	100 - 915	4" - 36"	50	151 - 450
			75	451 - 650
			90	651 - 825

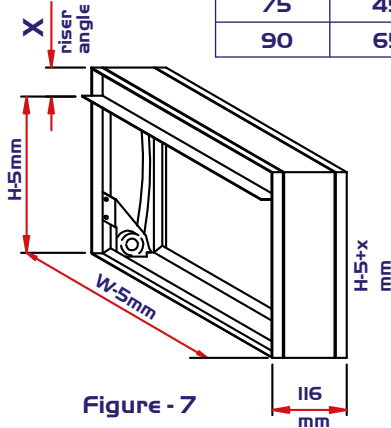


Figure - 7

FDCA NOT 100% FREE AREA

SIZES RANGE

	(mm)	(inches)
H	100 - 915	4" - 36"
W	100 - 915	4" - 36"

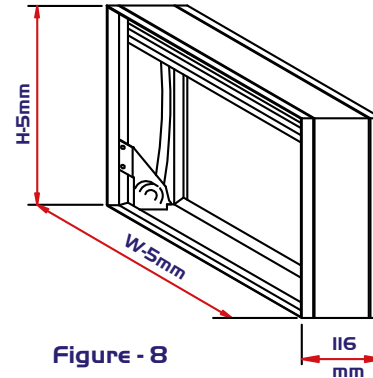


Figure - 8

MULTIPLE SECTION

FDCA NOT 100% FREE AREA

SIZES RANGE

Multiple Section

	(mm)	(inches)
H	above 915 - 1830	above 36" - 72"
W	above 915 - 1830	above 36" - 72"

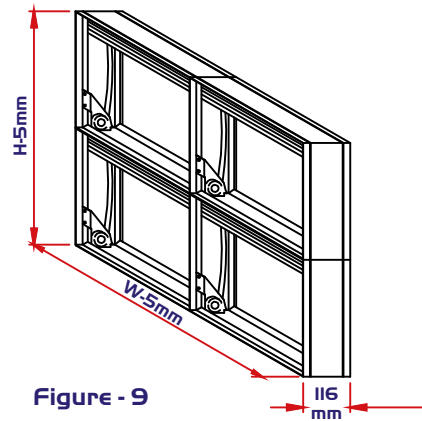


Figure - 9

Ordering Key:



STATIC	F	D	C	A	W	X	H	S	L	V	C	O	9
FIRE DAMPER FOR VERTICAL MOUNTING FOR STATIC APPLICATIONS													
- : 100% FREE AREA (STANDARD)													
A : NOT 100% FREE AREA													
SIZE: WIDTH X HEIGHT													
UP TO 36"X36" OUT-TO-OUT DIMENSIONS FOR SINGLE SECTION, AND 72"X72" OUT-TO-OUT DIMENSIONS FOR MULTIPLE SECTION.													
- : WITHOUT SLEEVE (STANDARD)													
SLVC09 : WITH 0.9 MM THICK G.I. SLEEVE													
SLVC12 : WITH 1.2MM THICK G.I. SLEEVE													
SLVC15 : WITH 1.5MM THICK G.I. SLEEVE													
SLVC20 : WITH 2.0MM THICK G.I. SLEEVE													





FIRE DAMPERS

FIRE DAMPER FOR DYNAMIC SYSTEMS - FDC/FDCA MODELS - SINGLE SECTIONS

FDC 100% FREE AREA



FDCA NOT 100% FREE AREA







FIRE DAMPER FOR DYNAMIC SYSTEMS - FDC/FDCA MODELS - SINGLE SECTIONS

FEATURES:

- UL classified for dynamic systems in accordance with UL 555 & NFPA 90A
- Civil Defence Approved
- Fusible link set at 165° F
- Fire rated for 1 ½ hour
- Mounting type: vertical
- Flow rating is 2000 cfm / ft²
- Static pressure is 4 in.wc

MAXIMUM UL CLASSIFIED SIZES (OUT TO OUT)		
section	MAXIMUM WIDTH (")	MAXIMUM HEIGHT (")
SINGLE	36	36

CONSTRUCTION

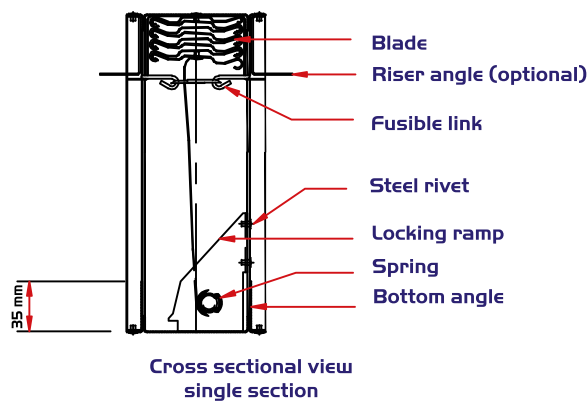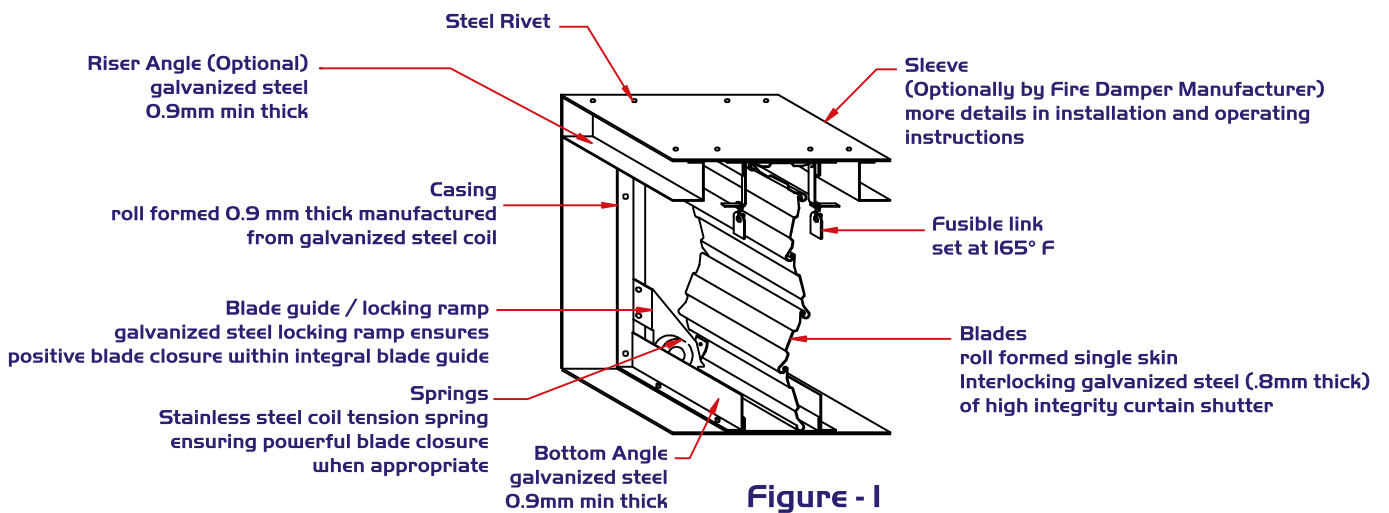



INSTALLATION AND OPERATING INSTRUCTIONS

1. The damper ① should be installed centrally within the surrounding masonry / gypsum floor or wall ⑦
2. The damper ① should be installed in a rectangular galvanized steel ② (optionally by Fire Damper Manufacturer) with a minimum thickness of 0.9mm. this sleeve should be attached to the damper not to the builder's work using steel rivets ⑤ 4.8mm dia. and spaced at not more than 225mm centers and 13 mm from corners (1/2")
3. The damper is suitable only for rectangular space and can not be use for annular space.
4. Allowance for expansion between sleeve and builders work in both horizontal and vertical planes to be 3mm per 305 mm of length and width.
5. The sleeve ② (optionally by Fire Damper Manufacturer) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork.
Minimum of 90 mm and maximum 152 mm beyond the floor or wall / include thicknesses of sleeve in table I.

Sleeve Thickness (mm)
0.9
1.2
1.5
2

TABLE I

6. The mounting angles ③ should be attached to the sleeve (optionally by Fire Damper Manufacturer) by 8mm dia ④ bolts at a maximum of 225mm centers, and should form a complete frame around the sleeve and cover over the expansion gap ⑥ required between sleeve and wall / floor opening. The four corners of the mounting angles are not to be welded. The bolts connecting the mounting angles to the sleeve to be 102 mm maximum from the corners Mounting angles will be send in loose parts.
7. The mounting angles ③ should be of such a size as always to form an overlap with the wall / floor by 25 mm minimum and should be manufactured from a minimum size of 35 x 35 x 2.5 mm GI angle.
8. A fusible link is UL tested, Elsie brand, set at 165° F
9. The duct-sleeve connection to be of as per what shown in (figure4) page 13.
Connecting ducts shall not be continuous and shall terminate at the sleeve.
Installation shall comply with NFPA 90A
10. All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

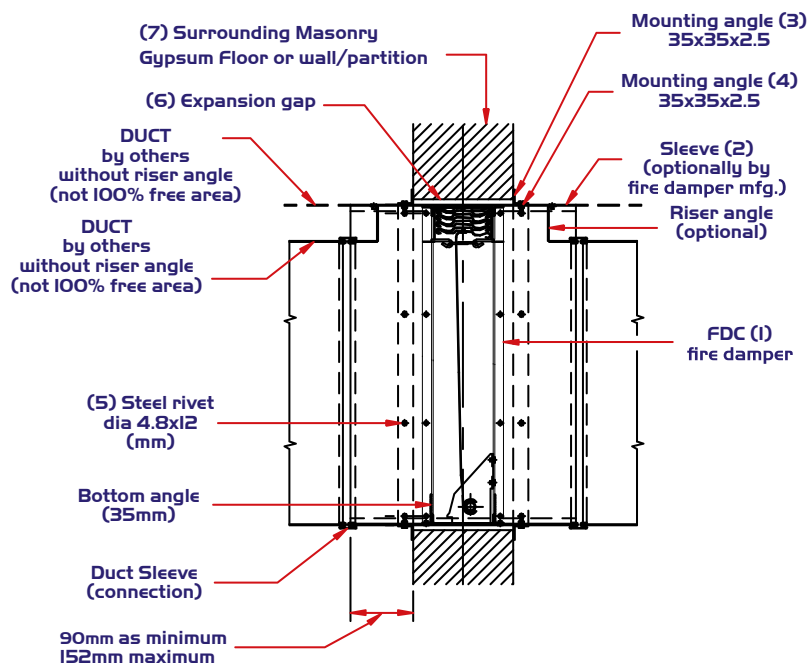


Figure 3 (CROSS SECTION DETAILS)
SINGLE SECTION FDC FIX TO WALL





DUCT - SLEEVE CONNECTIONS

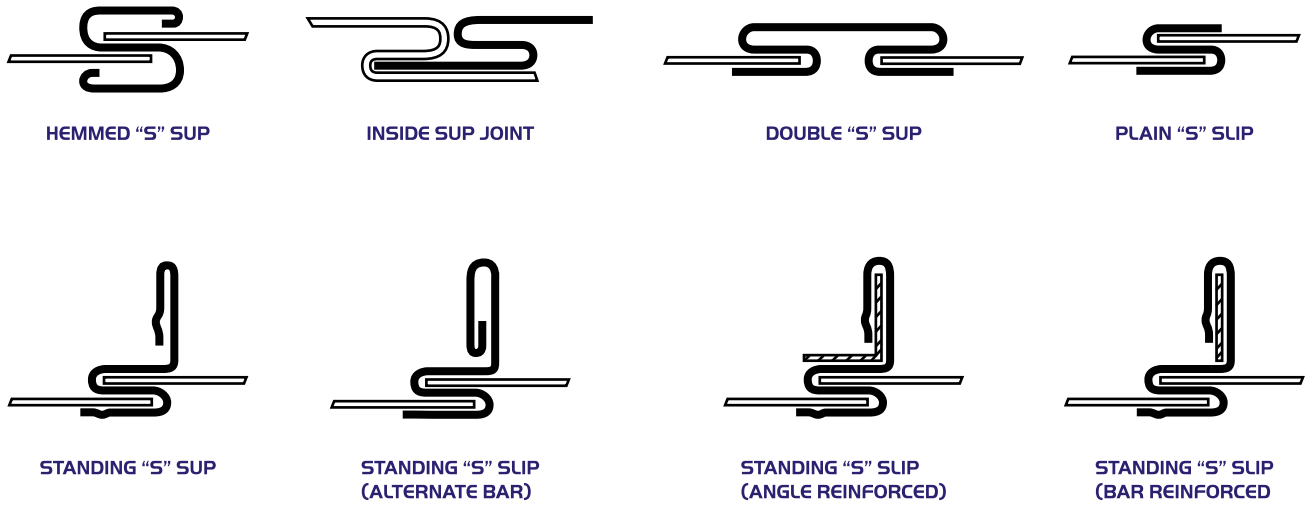


Figure - 4

EXPLODED ASSEMBLY FOR FDC TYPE WITH SLEEVE

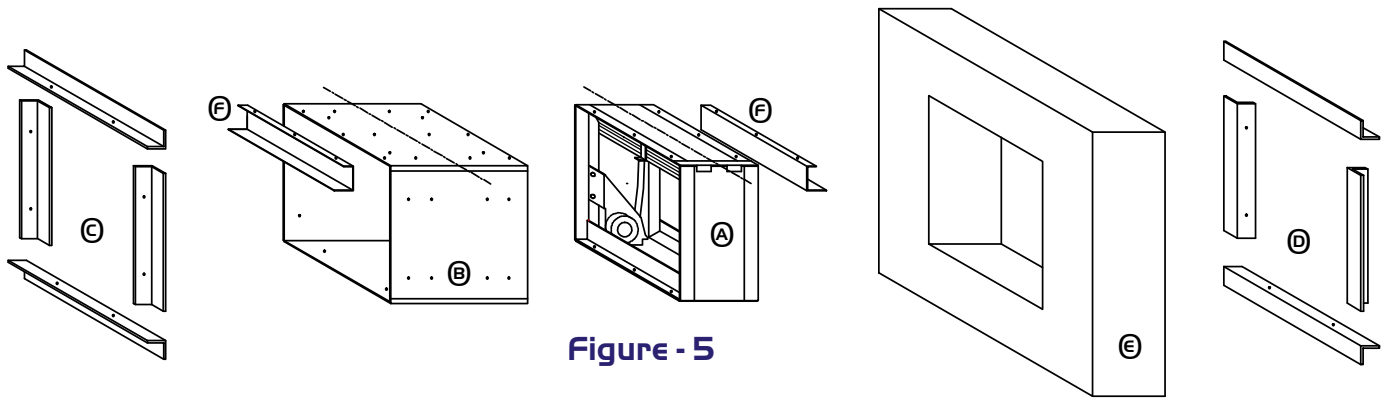


Figure - 5

ASSEMBLY PROCEDURES:

1. Fix the damper (A) into the sleeve (B) matching their center axis and hole provision using steel rivet.
2. If the riser angle (optional) is use then, fix the riser angle (F) (optional) into the fire damper sleeve matching their hole provision using steel rivet. If not go to step no.3.
3. Fix the fire damper with sleeve into the concrete / gypsum wall (E) opening by a front mounting angle (C) 35x35 matching their hole provision using M8 Hex bolt and nut. Opening size should have clearance of 3 mm per 305 mm of length and width.
4. Finally when the Fire Damper with sleeve is already fitted to the wall, fix the back mounting angle (D) 35 x 35 matching their hole provision using M8 Hex bolt and nut.





FIRE DAMPERS

ORDERING SYSTEM

FDC 100% FREE AREA

SIZES RANGE		
	(mm)	(inches)
H	80 - 825	3.2" - 32.5"
W	100 - 915	4" - 36"

X (mm)	H (mm)
25	80 - 150
50	151 - 450
75	451 - 650
90	651 - 825

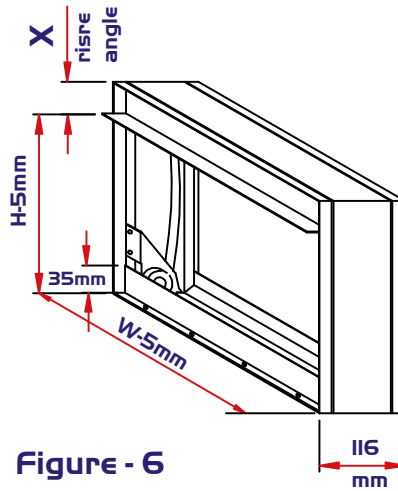


Figure - 6

FDCA NOT 100% FREE AREA

SIZES RANGE		
	(mm)	(inches)
H	100 - 915	4" - 36"
W	100 - 915	4" - 36"

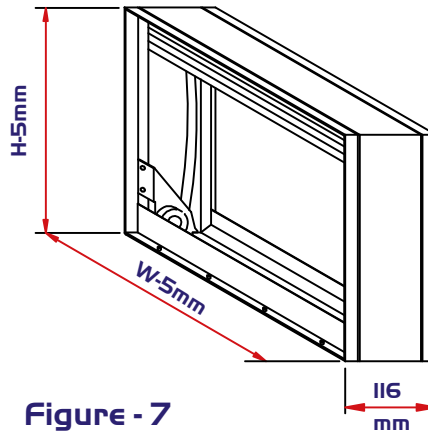


Figure - 7



Ordering Key:

DYNAMIC	F	D	C	A	W	X	H	S	L	V	C	O	9
FIRE DAMPER FOR VERTICAL MOUNTING FOR DYNAMIC APPLICATIONS													
- : 100% FREE AREA (STANDARD)													
A : NOT 100% FREE AREA													
SIZE: WIDTH X HEIGHT													
UP TO 36"X36" OUT-TO-OUT DIMENSIONS FOR SINGLE SECTION,													
- : WITHOUT SLEEVE (STANDARD)													
SLVC09 : WITH 0.9 MM THICK G.I. SLEEVE													
SLVC12 : WITH 1.2 MM THICK G.I. SLEEVE													
SLVC15 : WITH 1.5 MM THICK G.I. SLEEVE													
SLVC20 : WITH 2.0 MM THICK G.I. SLEEVE													





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

STANDARD CONSTRUCTION

Standards: Designed and tested in accordance with UL555 for STATIC applications. Meets NFPA 90A and SMACNA requirements for fire dampers.

Application: For fire barriers in STATIC applications.

Frame: 133mm Roll formed hat-shaped made of 1.4mm thick galvanized steel with reinforced corners, having integral bracing and 90° perpendicular overlap at a corner.

Blades: Roll formed 3 V-shaped made of 1.4mm thick galvanized steel.

Bushes: Bronze bushes.

Axles: 3/8" Square axles made of galvanized steel.

Linkage: Mechanical and concealed in frame.

Jamb Seals: Stainless steel jamb seals.

Drive Mechanism: 1/2" Round Jack Shaft made of galvanized steel.

Fusible link: UL Listed 165° F.

Sleeve: Sleeve made of 400mm depth and 1.1mm thickness galvanized steel.

Mounting: Vertical mounting.

Fire Rating: 3 hr (Model BFD)

Quadrant: Manual locking quadrant made of galvanized steel (becomes option for motorized models).

Sizes: Single Section: Max. 36" X 36"
Multiple Section: Max. 72" X 72"




Models BMFD-TF, BMFDLT-TF, BEMFD-TF & BEMFDLT-TF



Models BMFD/R, BMFDLT/R, BEMFD/R & BEMFDLT/R

Reducer on sleeve used when damper sizes are requested below 200x200mm

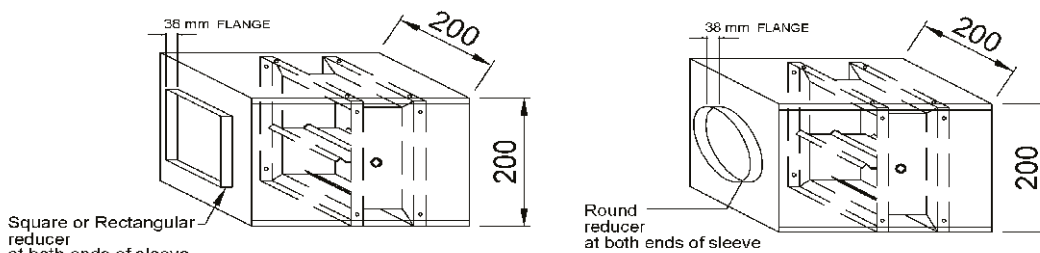



MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

OPTIONS



Models BFD-XS & BEFD-XS (without sleeve)

- Fire Rating: 1½ hr (Model BEFD)
- Without Sleeve with one side plate only (Models ended with "-XS").
- Round spigots for models BFD/R and BEFD/R.
- UL Listed 212° F fusible link.
- Motorized by an actuator from the following:
 - BELIMO 7.9 Nm (For dampers up to 36" X 36")
 - BELIMO 3.4 Nm (For dampers up to 20" x 20")
 - HONEYWELL 9 Nm (For dampers up to 36" X 36")
 - HONEYWELL 20 Nm (For dampers up to 72" X 36")
 - BELIMO 20 Nm (For 350. F Models Only)
- Manual locking quadrant made of galvanized steel (option for motorized models and standard for non motorized models).
- With UL Listed 165 F Thermal Responsive Device TRD instead of fusible link (BMFD-T & BEMFD-T).
- With BOTH UL Listed 165°F Thermal Responsive Device TRD and 212°F fusible link (BMFD-TF & BEMFD-TF).

	FEATURE	MODEL																																																			
		BFD-F165	BFD-F212	BFD/R-F165	BFD/R-F212	BEFD-F165	BEFD-F212	BEFD/R-F165	BEFD/R-F212	BMFD-F165	BMFDLT-F165	BMFD-F212	BMFDLT-F212	BMFD/R-F165	BMFDLT/R-F165	BMFD/R-F212	BMFDLT/R-F212	BMFD-T	BMFDLT-T	BMFD/R-T	BMFDLT/R-T	BMFD-TF	BMFDLT-TF	BMFD/R-TF	BMFDLT/R-TF	BEMFD-F165	BEMFDLT-F165	BEMFD-F212	BEMFDLT-F212	BEMFD/R-F165	BEMFDLT/R-F165	BEMFD/R-F212	BEMFDLT/R-F212	BEMFD-T	BEMFDLT-T	BEMFD/R-T	BEMFDLT/R-T	BEMFD/TF	BEMFDLT/TF	BEMFD/R-TF	BEMFDLT/R-TF												
USE	FIRE BARRIER	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	
	SMOKE BARRIER																																																				
SYSTEM	STATIC	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√		
	DYNAMIC																																																				
AIR FLOW RATING	2000 FPM																																																				
PRESSURE RATING	4 IWG																																																				
LEAKAGE CLASS	CLASS 2 - 250°F																																																				
FIRE RATING	3 HR	√	√	√	√					√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√		
	1½ HR					√	√	√	√																			√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√
MOTORIZED	NO	√	√	√	√	√	√	√	√																																												
	YES									√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	
ROUND SPIGOTS	WITH		√	√		√	√						√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√
	WITHOUT	√	√		√	√		√	√									√	√			√	√						√	√															√	√			√	√			
TEMPERATURE RESPONSIVE DEVICE	165°F FUSIBLE LINK	√	√	√	√	√	√	√	√				√	√												√	√			√	√																						
	212°F FUSIBLE LINK		√		√		√																																														
	"165°F RESETTABLE THERMOELECTRIC TRD"																	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√		
	165°F TRD & 212°F FUSIBLE LINK																								√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	
SLEEVE	WITH	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	√	
	WITHOUT																																																				

ABOVE MODELS WITHOUT ROUND SPIGOT CAN BE WITHOUT SLEEVE & WITH ONE SIDE PLATE WHEN THE MODEL ENDS BY "-XS"







MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

ASSEMBLY

Single section assembly up to 36" X36" (915X915mm)

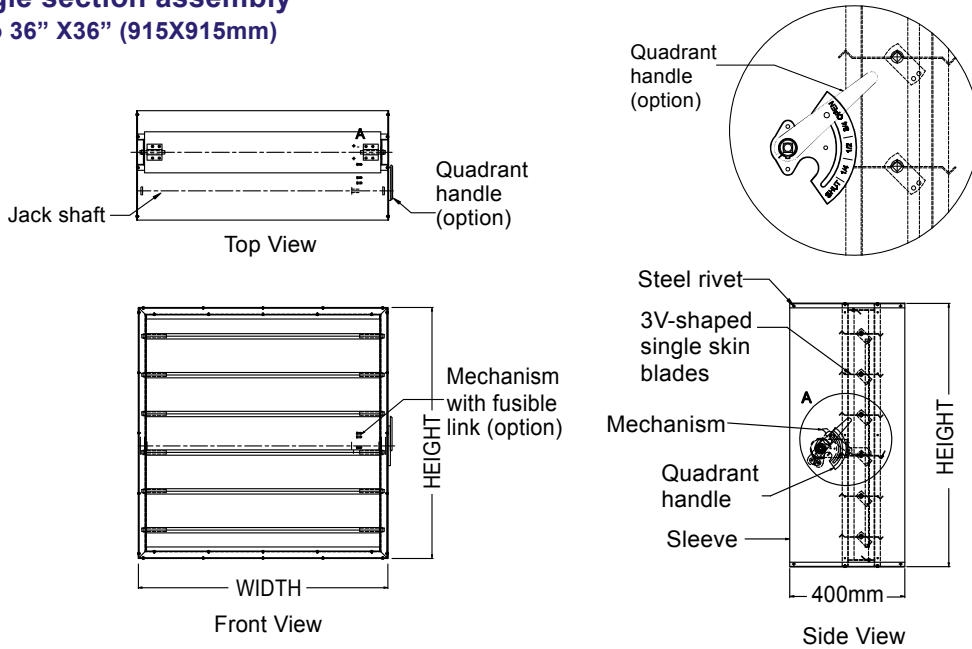


Multiple section assembly up to 72" X72" (1830X1830mm)

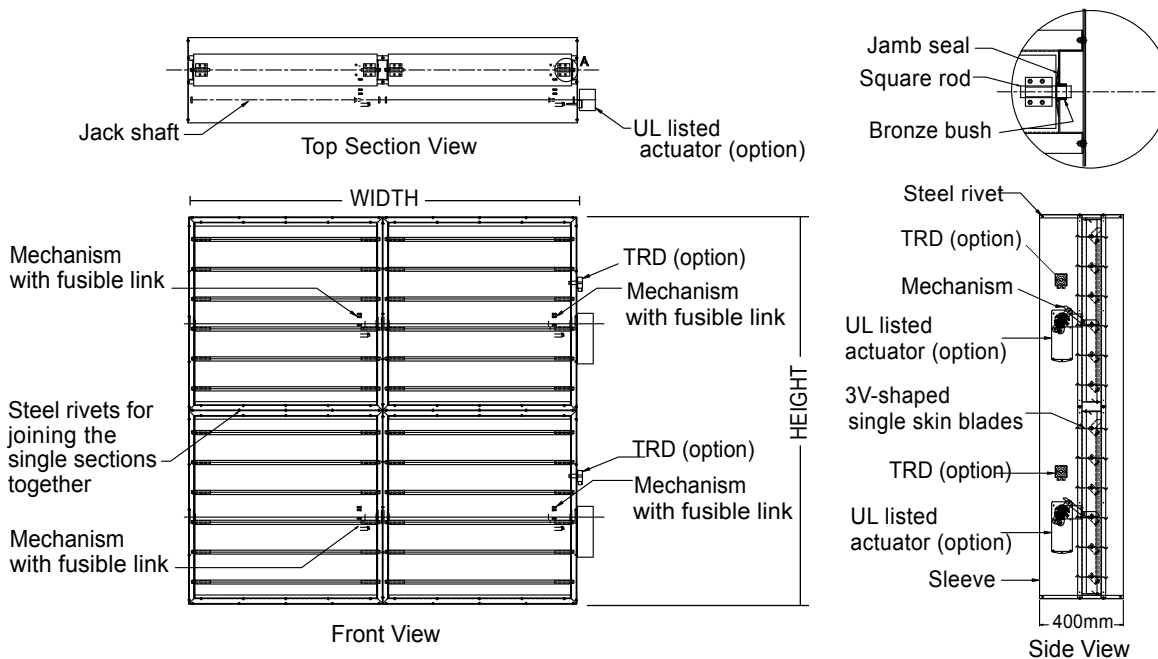



MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

PERFORMANCE DATA

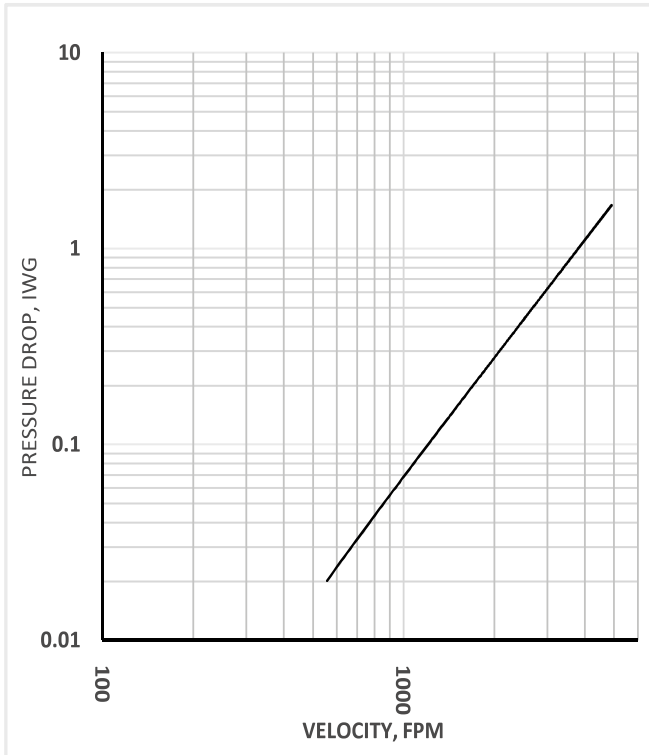

Note:
Pressure drop test was done at an independent laboratory in accordance with the AMCA 500-D standard on 36"X36" sample.



ORDERING KEY

STATIC	B	FD	/R8	-F165	SIZE	XS
-FOR STATIC SYSTEMS						
B: 3 HRS RATED BE: 1½ HRS RATED						
FD: MULTI-BLADES FIRE DAMPER - NOT MOTORIZED MFD: MOTORIZED MULTI-BLADES FIRE DAMPER						
--: WITHOUT ROUND SPIGOT /Rd: WITH ROUND SPIGOTS OF "d" DIA. ("d" IS DIAMETER IN INCH UP TO 32")						
-F165: WITH 165°F FUSIBLE LINK -F212: WITH 212°F FUSIBLE LINK -T: WITH 165°F RESETTABLE THERMOELECTRIC TRD -TF: WITH 165°F RESETTABLE THERMOELECTRIC TRD AND 212°F FUSIBLE LINK						
SIZE: WIDTH X HEIGHT -: WITH SLEEVE (STANDARD) XS: WITHOUT SLEEVE						





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(A)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-F, BMFDLT-F, BMFD/R-F, BMFDLT/R-F, BEMFD-F, BEMFDLT-F, BEMFD/R-F & BEMFDLT/R-F

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 1).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated at 165°F or 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to Impede proper closure.

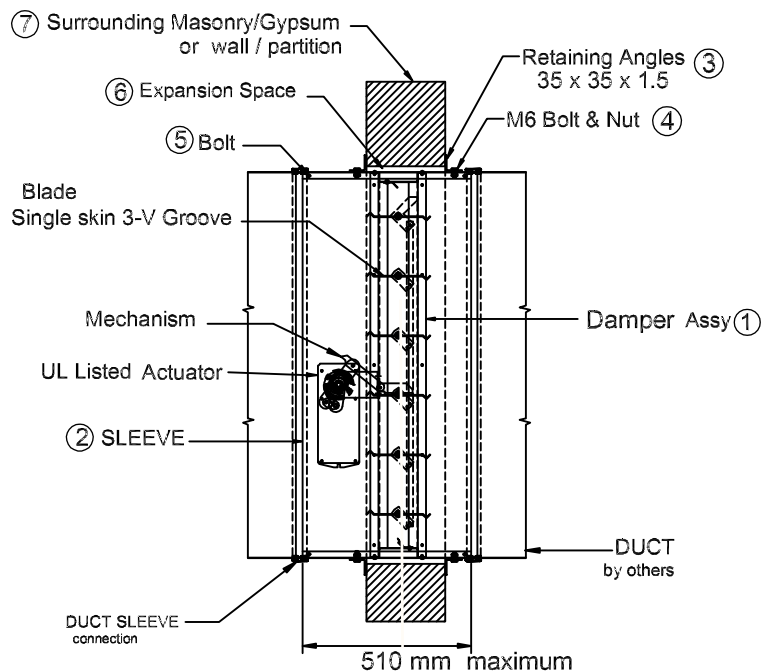


FIGURE 1





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(B)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-T, BMFDLT-T, BMFD/R-T, BMFDLT/R-T BEMFD-T, BEMFDLT-T, BEMFD/R-T & BEMFDLT/R-T

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 2).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) Push the re-set button to reset the TRD 165°F.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

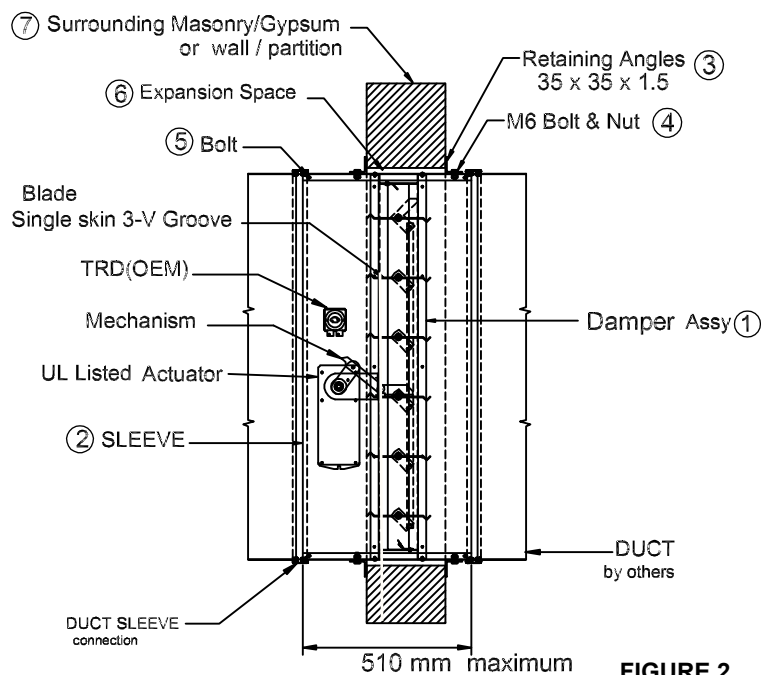


FIGURE 2





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(C)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-TF, BMFDLT-TF, BMFD/R-TF, BMFDLT/R-TF BEMFD-TF, BEMFDLT-TF, BEMFD/R-TF & BEMFDLT/R-TF

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 3).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.
- 10) Push the re-set button to reset the TRD (optional).

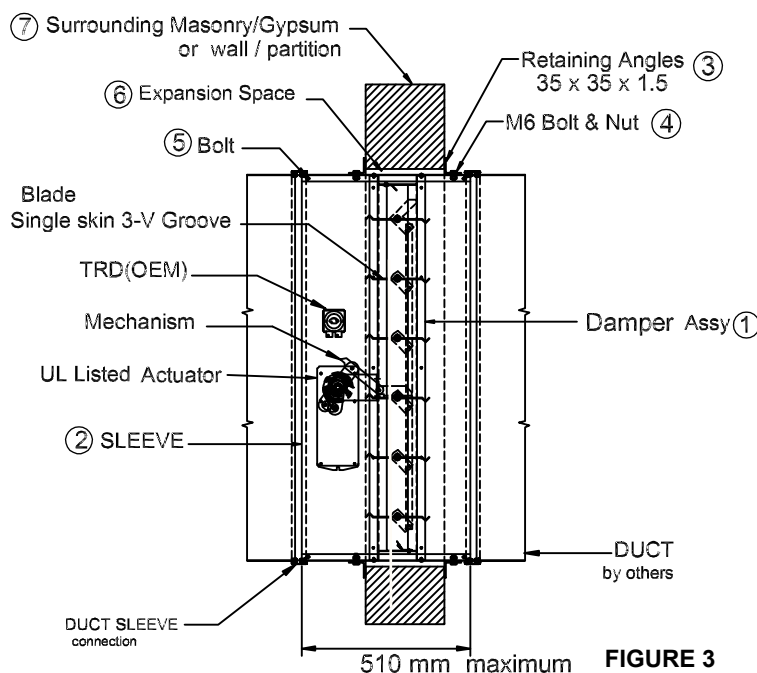


FIGURE 3





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(D) INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BFD-F, BEFD-F, BFD/R-F & BEFD/R-F

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 4).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated at 165°F or 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to Impede proper closure.
- 10) Lock the quadrant after adjusting the blade position / damper opening.

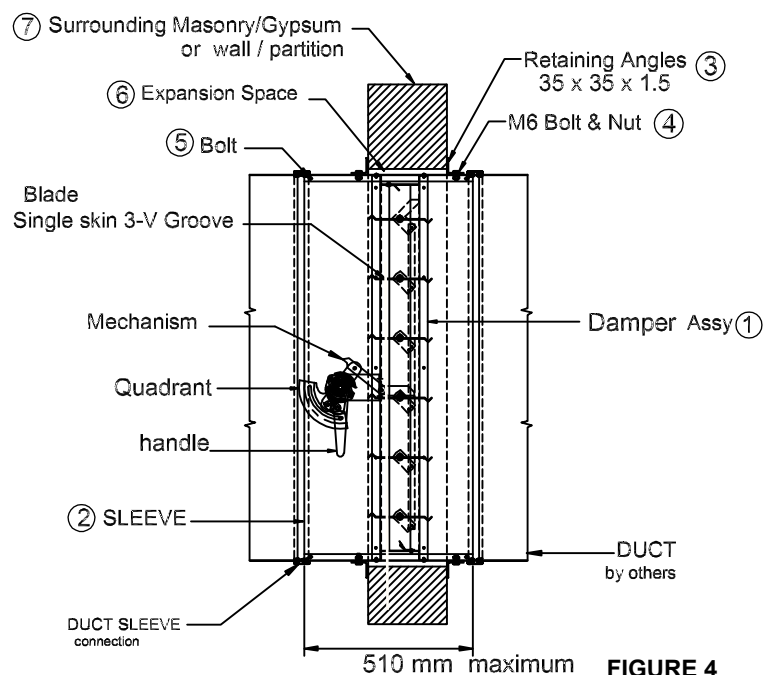


FIGURE 4






MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

EXPLODED ASSEMBLY WITH SLEEVE:

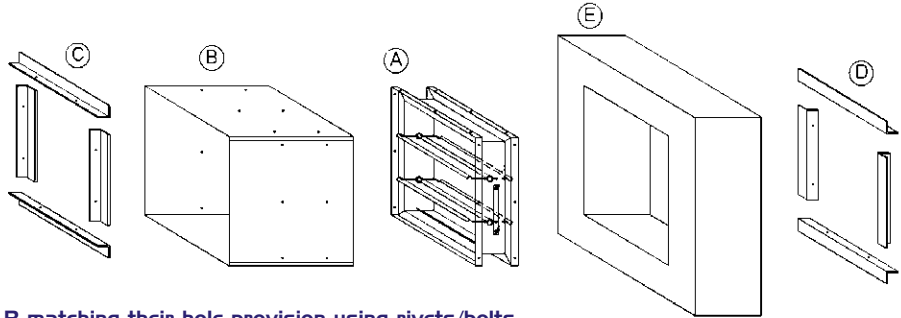


ASSEMBLY PROCEDURES:

- 1- Fix the damper A into the sleeve B matching their hole provision using rivets/bolts.
- 2- Fix the damper with sleeve into the concrete/gypsum wall opening E using the front retaining angle C 35X35 and matching their hole provision using M6 Hex bolt & nut. The sleeve B must overhang by a minimum of 90mm and maximum of 152mm. Opening size should have clearance of 3mm per 305mm of width and height.
- 3- Finally, when the subassembly is already fitted to the wall, fix the back retaining angle D 35X35 using M6 Hex bolt & nut.


DUCT-SLEEVE CONNECTIONS

FLANGED BREAKWAY CONNECTIONS:

TDC AND TDF ROLL-FORMED 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS, METAL CLEATS AND FOUR 9.5 mm METAL NUTS AND BOLTS.

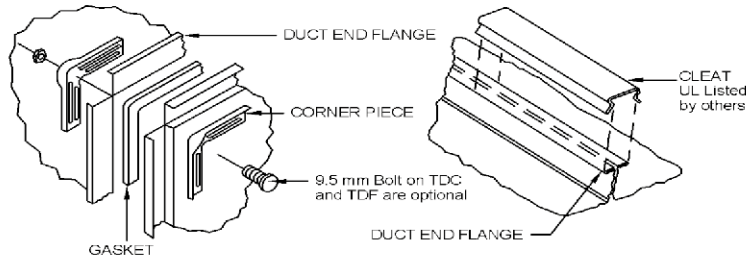


MANUFACTURED SLIP ON 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS AND PLASTIC CLEATS AS SHOWN BELOW.

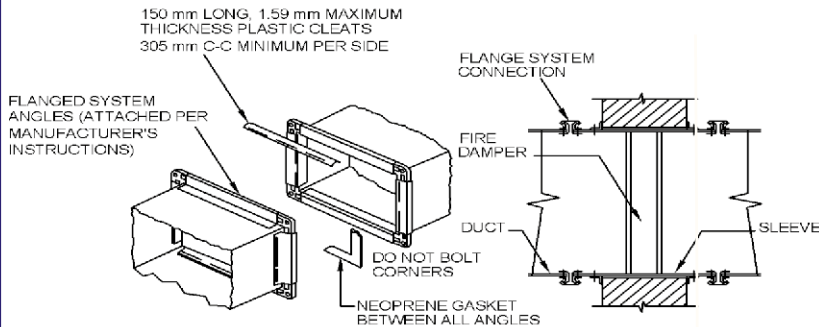

(UL TESTED CONNECTIONS BY OTHERS)

TRANSVERSE JOINTS BREAKWAY CONNECTIONS (WITHOUT FLANGES):

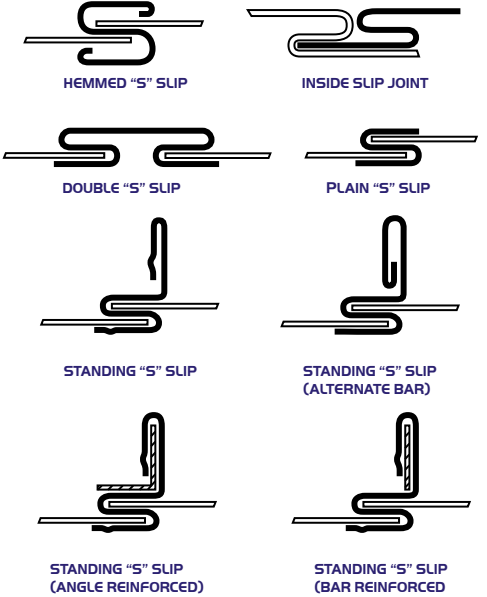

R21930





MULTI-BLADE UL CLASSIFIED STATIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION / STEEL MULLIONS

MANUFACTURING AND FIELD INSTALLATION INSTRUCTIONS FOR STEEL MULLIONS (as per SMACNA):

The mullions are used / necessary whenever the fire damper is installed into and opening that is larger than the largest UL rated size for the damper. The damper fire rated 1-1/2 hours.

Vertical, horizontal or vertical and horizontal mullions can be used depending on the area at the opening. The opening must not exceed 120" (inch) height, but it can be any width provided a vertical support mullion is used a maximum of every 120" (inch).

The mullions must be kept out of the air stream. For ducted system each subdivided opening (e.g. A x B) must be ducted individually.

The mullions are for using concrete block or poured walls only. The thickness of the wall is min, 177mm and max, 300mm.








INSTALLATION

The END CAPS are attached to wall opening by means of 25mm long and 9mm Dia steel expansion anchor embedded with M6 list headed screws.

If a steel inlet are used then make welding 2 x 25mm long weld per length / each side of the mullions (eg. Before installing the End Caps make sure that they are inserted in the ends of the mullions).

NOTES:

- (a) After installations of steel mullions refer installation page of the fire damper which is provided by the manufacturer.
- (b) Do not fastened retaining angle to the wall or steel mullions. The steel mullions must be free to float.

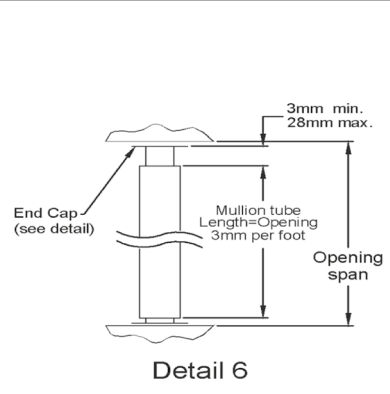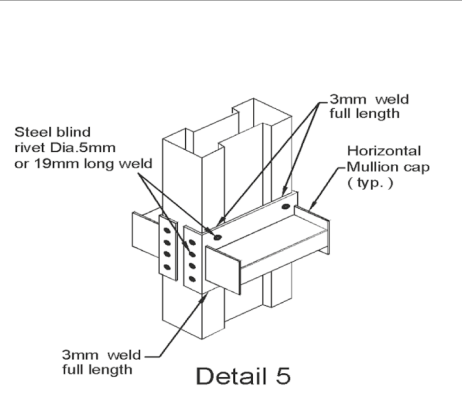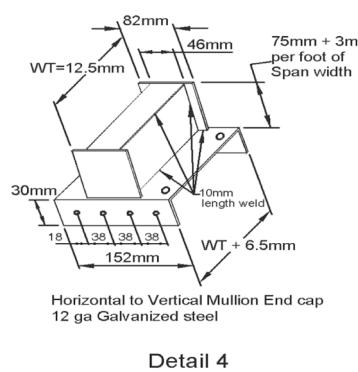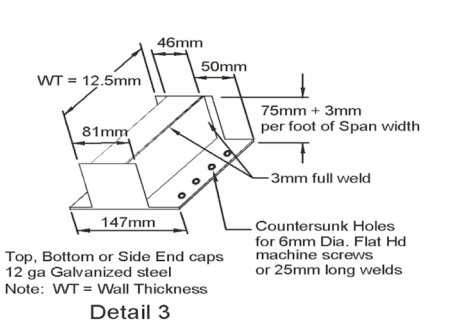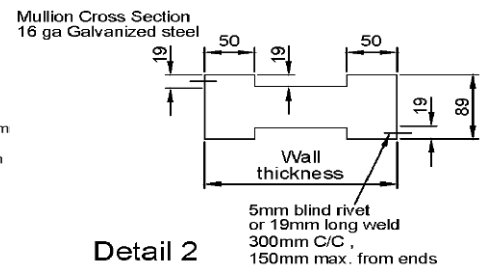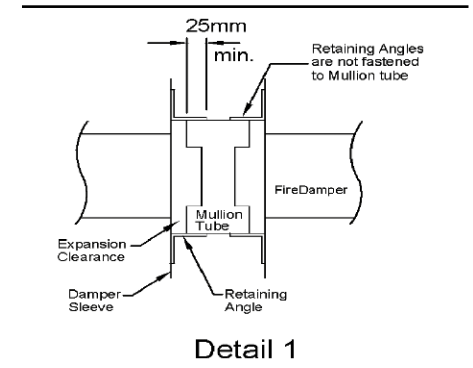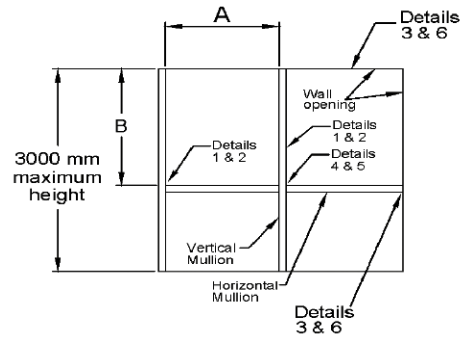



MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

STANDARD CONSTRUCTION

- Standards:** Designed and tested in accordance with UL555 for DYNAMIC applications. Meets NFPA 90A and SMACNA requirements for fire dampers.
- Application:** For fire barriers in DYNAMIC systems.
- Frame:** 133mm Roll formed hat-shaped made of 1.4mm thick galvanized steel with reinforced corners, having integral bracing and 90° perpendicular overlap at a corner.
- Blades:** Roll formed 3 V-shaped made of 1.4mm thick galvanized steel.
- Bushes:** Bronze bushes.
- Axles:** 3/8" Square axles made of galvanized steel.
- Linkage:** Mechanical and concealed in frame.
- Drive Mechanism:** 1/2" Round Jack Shaft made of galvanized steel.
- Jamb Seals:** Stainless steel jamb seals.




Models BMFD-TF, BMFDLT-TF, BEMFDLT-TF & BEMFD-TF

- Fusible link:** UL Listed 165° F.
- Sleeve:** Sleeve made of 400mm depth and 1.1mm thickness galvanized steel.
- Mounting:** Vertical mounting.
- Fire Rating:** 3 hr (Model BFD)
- Max. Pressure:** 4 IWG
- Max. Velocity:** 2000 FPM
- Quadrant:** Manual locking quadrant made of galvanized steel (becomes option for motorized models).
- Sizes:** Single Section: Max. 36" X 36"
Multiple Section: Max. 72" X 72"



Models BMFD/R, BMFDLT/R, BEMFDLT/R & BEMFD/R

Reducer on sleeve used when damper sizes are requested below 200X200mm

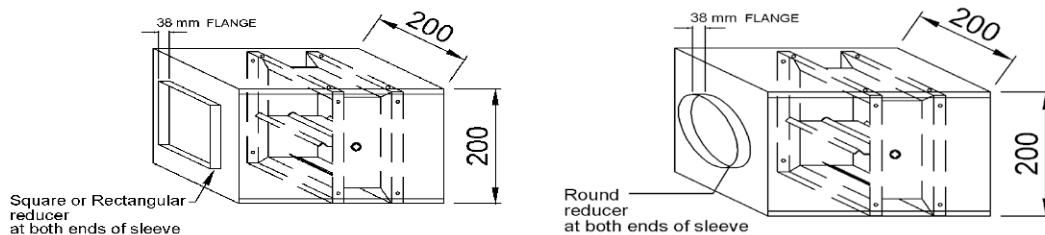




MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

OPTIONS

- Fire Rating: 1½ hr (Model BEFD)
- Without Sleeve. With one side plate only.
- Round spigots for models BFD/R and BEFD/R.
- UL Listed 212° F fusible link.
- Motorized by an actuator from the following:
 - BELIMO 7.9 Nm (For dampers up to 36" X 36")
 - BELIMO 3.4 Nm (For dampers up to 20" x 20")
 - HONEYWELL 9 Nm (For dampers up to 36" X 36")
 - HONEYWELL 20 Nm (For dampers up to 72" X 36")
 - BELIMO 20 Nm (For 350°F Models Only)
- Manual locking quadrant made of galvanized steel (option for motorized models and standard for non motorized models).
- With UL Listed 165° F Thermal Responsive Device TRD instead of fusible link (BMFD-T & BEMFD-T).
- With BOTH UL Listed 165° F Thermal Responsive Device TRD and 212° F fusible link (BMFD-TF & BEMFD-TF).

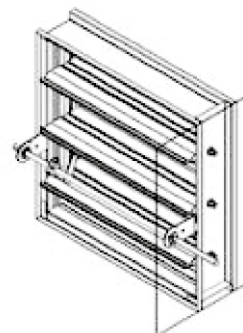

Models BFD-XS & BEFD-XS
(without sleeve)

FEATURE	MODEL	BFD-F165	BFD-F212	BFD/R-F165	BFD/R-F212	BEFD-F165	BEFD-F212	BEFD/R-F165	BEFD/R-F212	BMFDF165	BMFDF212	BMFDR-F165	BMFDR-F212	BMFDR-F212	BMFD-T	BMFDLT-T	BMFD/R-T	BMFDLT/R-T	BMFD-TF	BMFDLT-TF	BMFD/R-TF	BMFDLT/R-TF	BEMFD-F165	BEMFD-F212	BEMFD/R-F165	BEMFD/R-F212	BEMFDLT/R-F212	BEMFD-T	BEMFDLT-T	BEMFD/R-T	BEMFDLT/R-T	BEMFD-TF	BEMFDLT-TF	BEMFD/R-TF	BEMFDLT/R-TF					
		USE	FIRE BARRIER	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
	SMOKE BARRIER																																							
SYSTEM	STATIC																																							
	DYNAMIC	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
AIR FLOW RATING	2000 FPM	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
PRESSURE RATING	4 IWG	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
LEAKAGE CLASS	CLASS 2 - 250°F																																							
FIRE RATING	3 HR	✓	✓	✓	✓																																			
	1½ HR					✓	✓	✓	✓															✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
MOTORIZED	NO	✓	✓	✓	✓	✓	✓	✓	✓																															
	YES									✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
ROUND SPIGOTS	WITH			✓	✓					✓	✓												✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
	WITHOUT	✓	✓			✓	✓			✓	✓				✓	✓				✓	✓			✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
TEMPERATURE RESPONSIVE DEVICE	165°F FUSIBLE LINK	✓		✓	✓	✓	✓			✓	✓												✓	✓																
	212°F FUSIBLE LINK	✓		✓		✓		✓			✓													✓	✓			✓	✓											
	"165°F RESETTABLE THERMOELECTRIC TRD"														✓	✓	✓	✓	✓											✓	✓	✓	✓							
	165°F TRD & 212°F FUSIBLE LINK																			✓	✓	✓	✓													✓	✓	✓	✓	
SLEEVE	WITH	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	
	WITHOUT																																							

ABOVE MODELS WITHOUT ROUND SPIGOT CAN BE WITHOUT SLEEVE & WITH ONE SIDE PLATE WHEN THE MODEL ENDS BY "-XS"













MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

ASSEMBLY

Single section assembly up to 36" X36" (915X915mm)

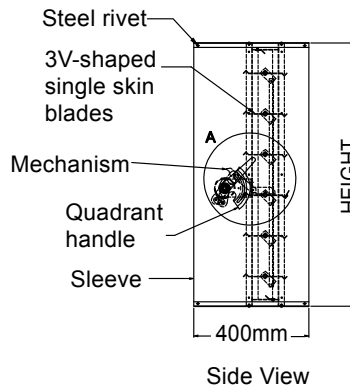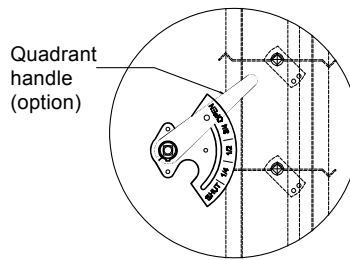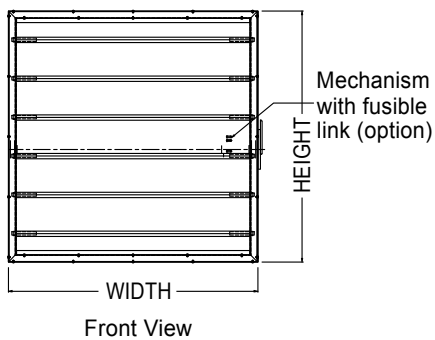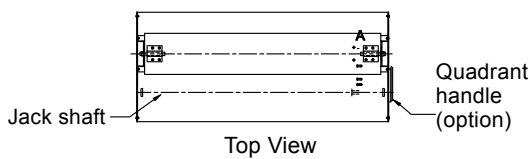


Multiple section assembly up to 72" X72" (1830X1830mm)

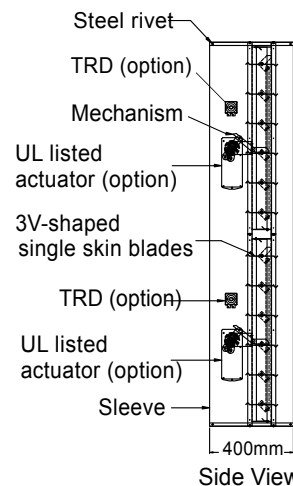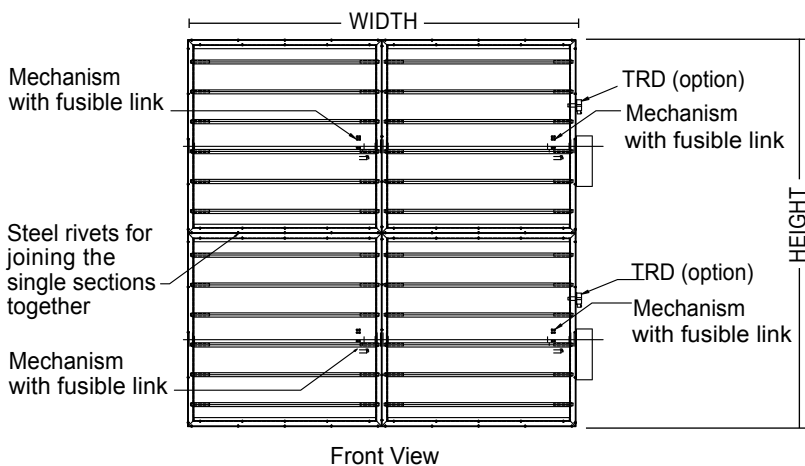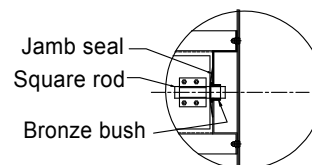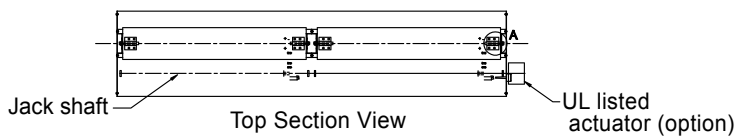



MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

PERFORMANCE DATA

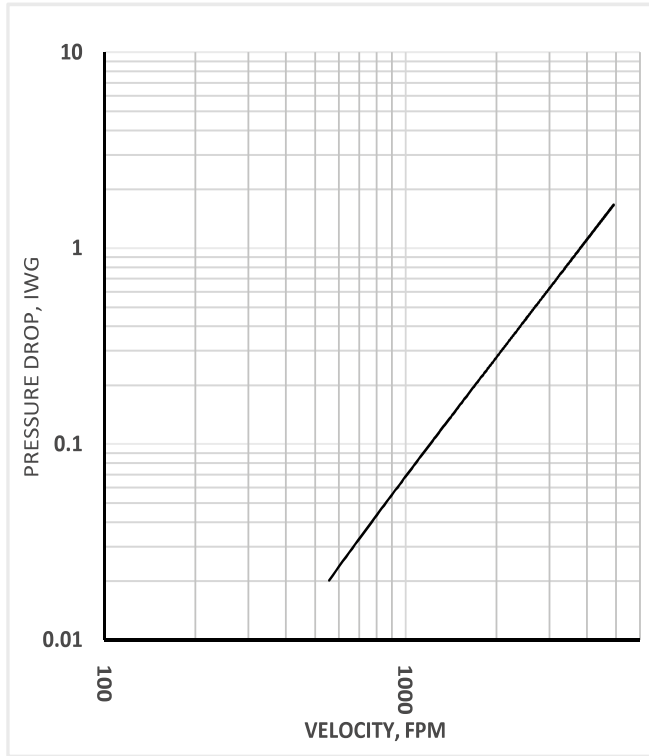

Note:
Pressure drop test was done at an independent laboratory in accordance with the AMCA 500-D standard on 36"X36" sample.



ORDERING KEY

STATIC	B	FD	/R8	-F165	SIZE	XS
-FOR DYNAMIC SYSTEMS						
B: 3 HRS RATED BE: 1½ HRS RATED						
FD: MULTI-BLADES FIRE DAMPER - NOT MOTORIZED MFD: MOTORIZED MULTI-BLADES FIRE DAMPER						
---: WITHOUT ROUND SPIGOT /Rd: WITH ROUND SPIGOTS OF "d" DIA. ("d" IS DIAMETER IN INCH UP TO 32")						
-F165: WITH 165°F FUSIBLE LINK -F212: WITH 212°F FUSIBLE LINK -T: WITH 165°F RESETTABLE THERMOELECTRIC TRD -TF: WITH 165°F RESETTABLE THERMOELECTRIC TRD AND 212°F FUSIBLE LINK						
SIZE: WIDTH X HEIGHT ---: WITH SLEEVE (STANDARD) XS: WITHOUT SLEEVE						





MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(A)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-F, BMFDLT-F, BMFD/R-F, BMFDLT/R-F, BEMFD-F, BEMFDLT-F, BEMFD/R-F & BEMFDLT/R-F

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 1).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated at 165°F or 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to Impede proper closure.

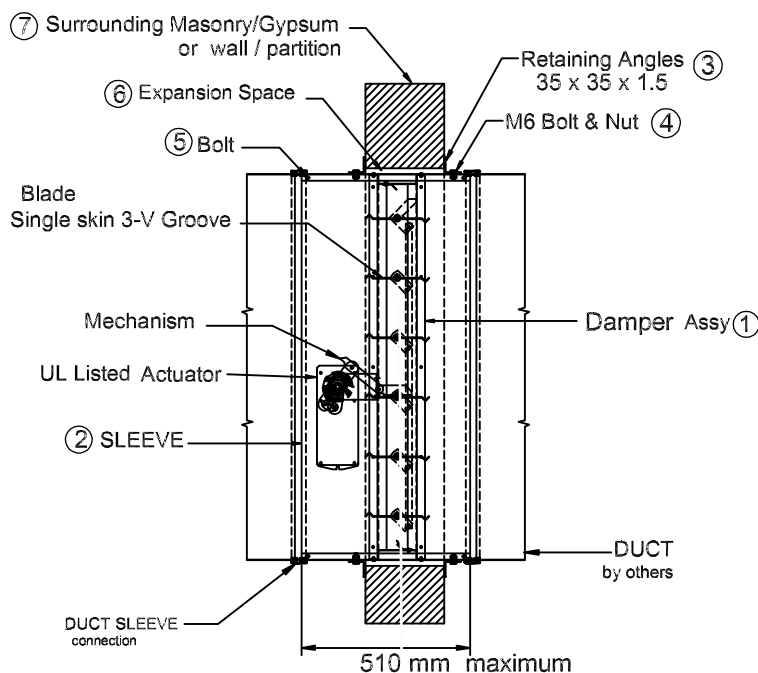


FIGURE 1





MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(B)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-T, BMFDLT-T, BMFD/R-T, BMFDLT/R-T, BEMFD-T, BEMFDLT-T, BEMFD/R-T & BEMFDLT/R-T

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 2).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) Push the re-set button to reset the TRD 165°F.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

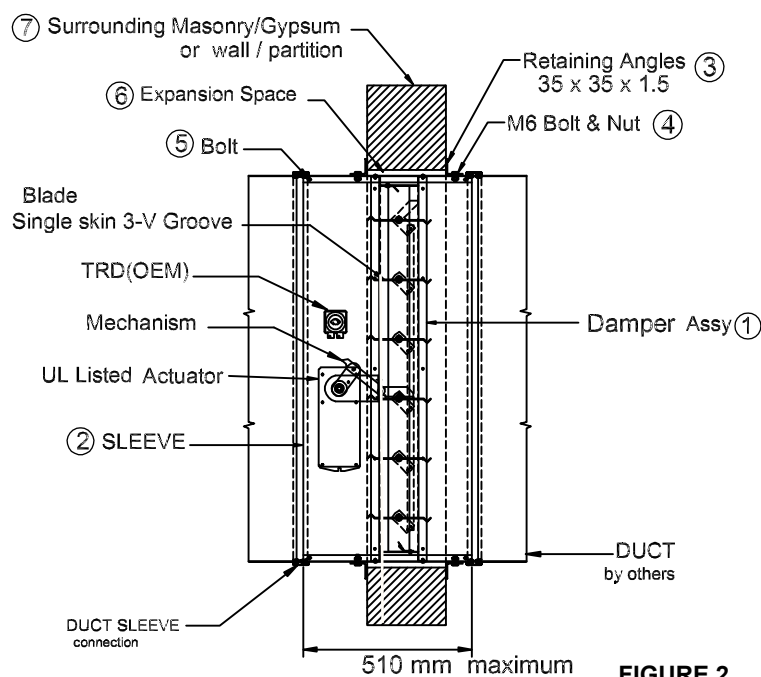


FIGURE 2





MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(C)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFD-TF, BMFDLT-TF, BMFD/R-TF, BMFDLT/R-TF, BEMFD-TF, BEMFDLT-TF, BEMFD/R-TF & BEMFDLT/R-TF

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 3).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to Impede proper closure.
- 10) Push the re-set button to reset the TRD (optional).

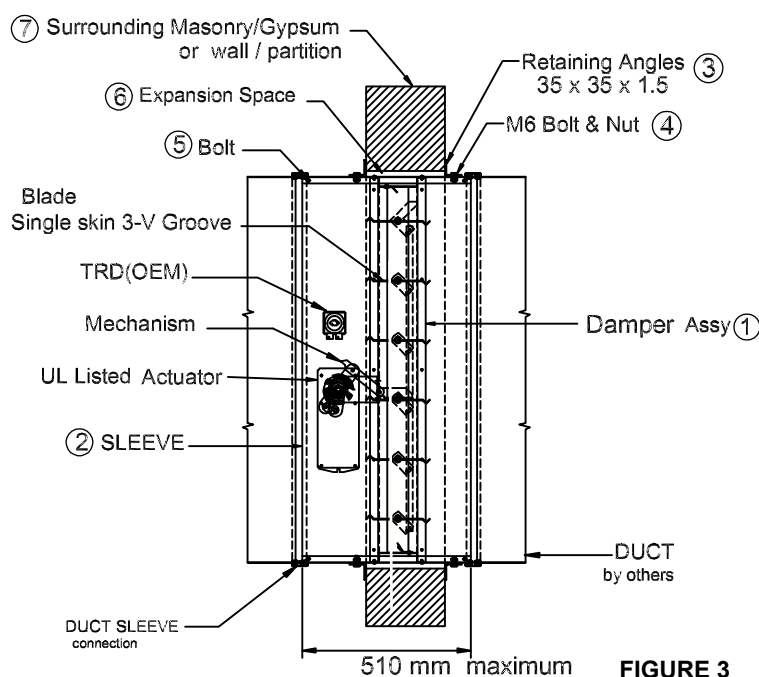


FIGURE 3





MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

(D) INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BFD-F, BEFD-F, BFD/R-F & BEFD/R-F

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 4).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10 mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90mm from the wall and total depth of the sleeve should not exceed more than 510mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts. Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5mm GI.
- 7) A fusible link –Elsle model-E rated at 165°F or 212°F used.
- 8) The duct sleeve connection to be of as per listed in UL 555. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.
- 10) Lock the quadrant after adjusting the blade position / damper opening.

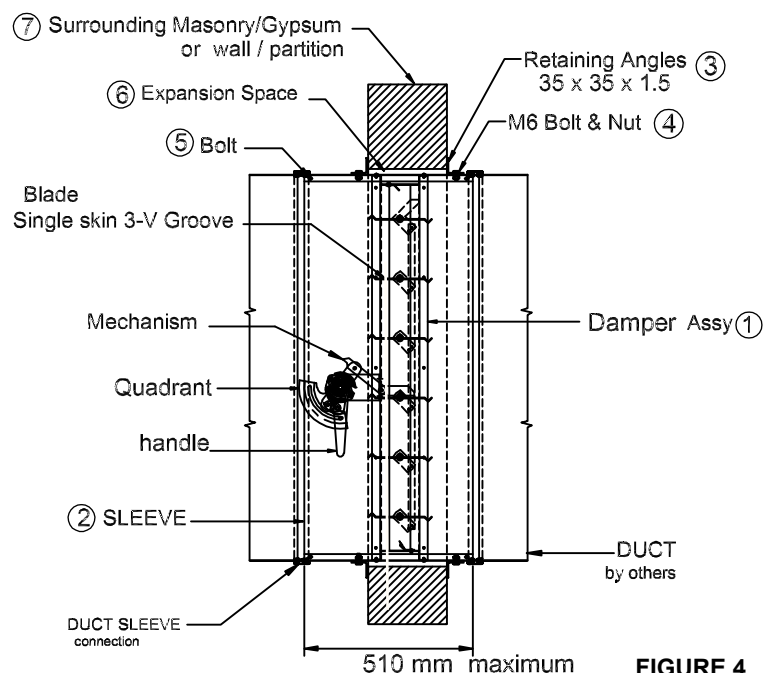


FIGURE 4






MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION

EXPLODED ASSEMBLY WITH SLEEVE:

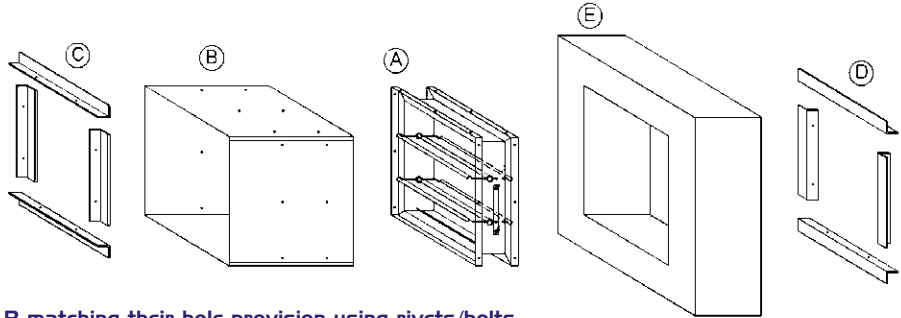


ASSEMBLY PROCEDURES:

- 1- Fix the damper A into the sleeve B matching their hole provision using rivets/bolts.
- 2- Fix the damper with sleeve into the concrete/gypsum wall opening E using the front retaining angle C 35X35 and matching their hole provision using M6 Hex bolt & nut. The sleeve B must overhang by a minimum of 90mm and maximum of 152mm. Opening size should have clearance of 3mm per 305mm of width and height.
- 3- Finally, when the subassembly is already fitted to the wall, fix the back retaining angle D 35X35 using M6 Hex bolt & nut.


DUCT-SLEEVE CONNECTIONS

FLANGED BREAKWAY CONNECTIONS:

TDC AND TDF ROLL-FORMED 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS, METAL CLEATS AND FOUR 9.5 mm METAL NUTS AND BOLTS.

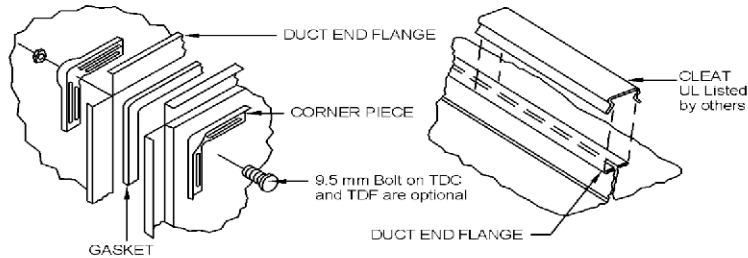


MANUFACTURED SLIP ON 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS AND PLASTIC CLEATS AS SHOWN BELOW.

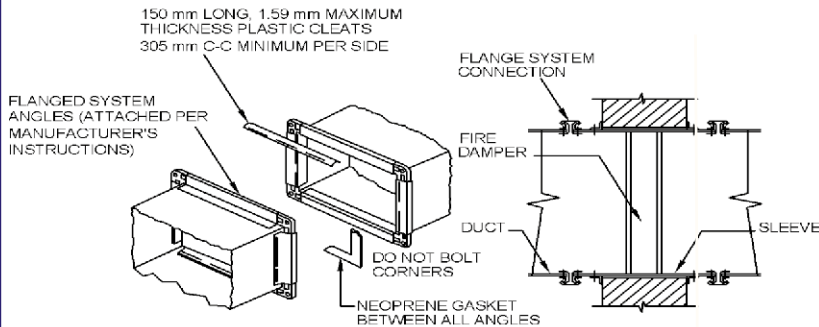

(UL TESTED CONNECTIONS BY OTHERS)

TRANSVERSE JOINTS BREAKWAY CONNECTIONS (WITHOUT FLANGES):

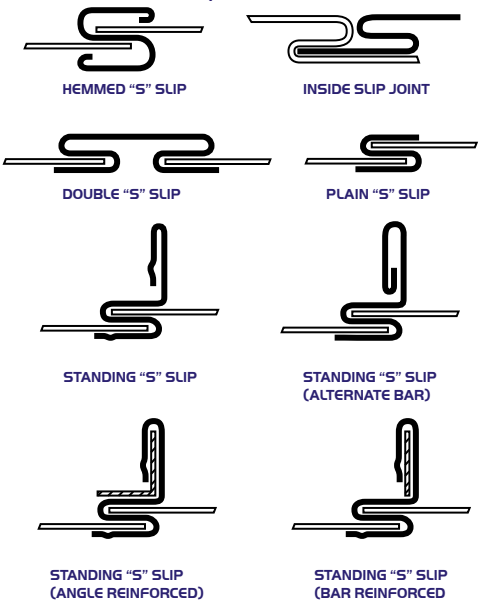

R21930





MULTI-BLADE UL CLASSIFIED DYNAMIC FIRE DAMPER MODEL BFD (3 HR) / MODEL BEFD (1½ HR)

INSTALLATION / STEEL MULLIONS

MANUFACTURING AND FIELD INSTALLATION INSTRUCTIONS FOR STEEL MULLIONS (as per SMACNA):

The mullions are used / necessary whenever the fire damper is installed into an opening that is larger than the largest UL rated size for the damper. The damper fire rated 1-1/2 hours.

Vertical, horizontal or vertical and horizontal mullions can be used depending on the area at the opening. The opening must not exceed 120" (inch) height, but it can be any width provided a vertical support mullion is used a maximum of every 120" (inch).

The mullions must be kept out of the air stream. For ducted system each subdivided opening (e.g. A x B) must be ducted individually.

The mullions are for using concrete block or poured walls only. The thickness of the wall is min, 177mm and max, 300mm.

INSTALLATION








The END CAPS are attached to wall opening by means of 25mm long and 9mm Dia steel expansion anchor embedded with M6 list headed screws.

If a steel inlet are used then make welding 2 x 25mm long weld per length / each side of the mullions (eg. Before installing the End Caps make sure that they are inserted in the ends of the mullions).

NOTES:

(a) After installations of steel mullions refer installation page of the fire damper which is provided by the manufacturer.

(b) Do not fastened retaining angle to the wall or steel mullions. The steel mullions must be free to float.

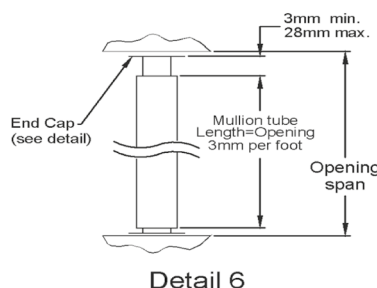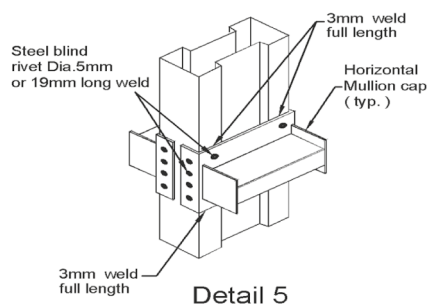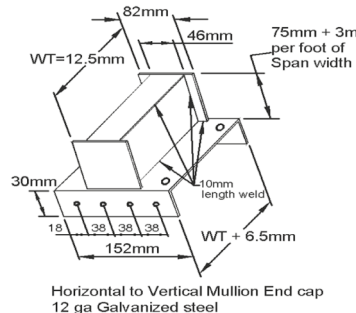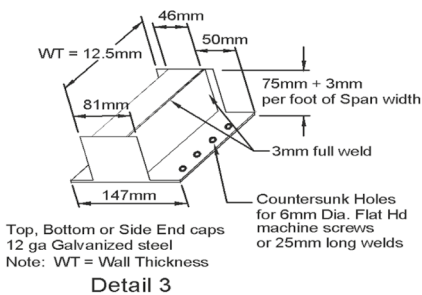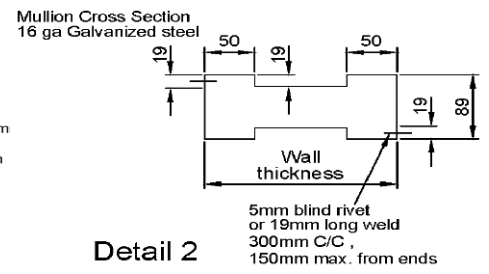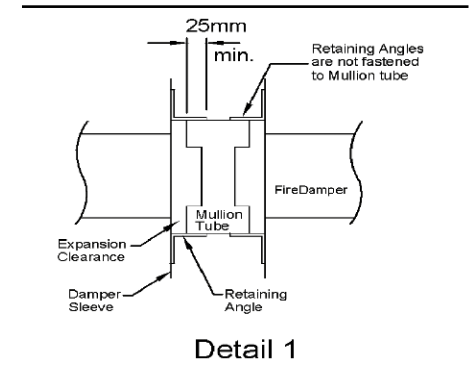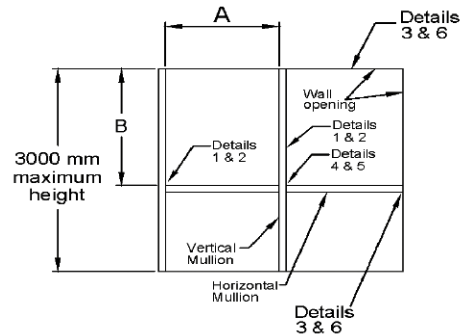



COMBINATION FIRE/SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)

STANDARD CONSTRUCTION

Standards: Designed and tested in accordance with UL555 & UL555S. Meets NFPA 90A and SMACNA requirements for fire & smoke dampers.

Application: For fire & smoke barriers in dynamic fire & smoke management systems.

Frame: 133mm Roll formed hat-shaped made of 1.4mm thick galvanized steel with reinforced corners, having integral bracing and 90° perpendicular overlap at a corner.

Blades: Roll formed 3 V-shaped made of 1.4mm thick galvanized steel.

Bushes: Bronze bushes.

Axles: ¾" Square axles made of galvanized steel.

Linkage: Mechanical and concealed in frame.

Drive Mechanism: ½" Round Jack Shaft made of galvanized steel.

Jamb Seals: Stainless steel jamb seals.

Blades Seals: UL listed high-temperature (exceeding 450°F) Silicone blades edges seal/gasket manufactured in accordance with UL555S requirements.

Temperature Responsive Device: Resettable Thermoelectric set at 165° F.

Actuators: A UL listed HONEYWELL 3.4 Nm actuator for each single section damper up to 20"X20"
A UL listed HONEYWELL 9 Nm actuator for each single section damper up to 36"X36".
A UL listed BELIMO 20Nm actuator for each single section damper up to 36"X36"

Sleeve: Sleeve made of 400mm depth and 1.1mm thickness galvanized steel.

Mounting: Vertical mounting.

Fire Rating: 3 hr (Model BMFSD).

Air Flow Rating: 2000 FPM / 4 IWG.

Leakage: Available in Class I @ 350°F
Class I @ 250°F
Class 2 @ 250°F

Sizes: Single Section: Max. 36" X 36"
Multiple Section: Max. 72" X 72"



Models BMFSD-T, BMFSDLT-T,
BEMFSDLT-T & BEMFSD-T





COMBINATION FIRE/SMOKE DAMPER

CLASS 1 - 350°F - CLASS 1 - 250°F - CLASS 2 - 250°F
 MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)


OPTIONS

- Fire Rating: 1½ hr (Model BEMFSD & BEMFSDLT).
- Without Sleeve. With one side plate only (Models BMFSD-XS, BEMFSD-XS, BMFSDLT-XS & BEMFSDLT-XS).
- Round spigots for models BMFSD/R, BEMFSD/R, BMFSDLT/R & BEMFSDLT/R.

FEATURE	MODEL	BMFSD-T	BMFSD/R-T	BEMFSD-T	BEMFSD/R-T	BMFSDLT-T	BMFSDLT/R-T	BEMFSDLT-T	BEMFSDLT/R-T
		USE	FIRE BARRIER	✓	✓	✓	✓	✓	✓
	SMOKE BARRIER	✓	✓	✓	✓	✓	✓	✓	✓
SYSTEM	STATIC								
	DYNAMIC	✓	✓	✓	✓	✓	✓	✓	✓
AIR FLOW RATING	2000 FPM	✓	✓	✓	✓	✓	✓	✓	✓
PRESSURE RATING	4 IWG	✓	✓	✓	✓	✓	✓	✓	✓
LEAKAGE CLASS	CLASS 1 - 350	✓	✓	✓	✓				
	CLASS 1 - 250	✓	✓	✓	✓	✓	✓	✓	✓
	CLASS 2 - 250	✓	✓	✓	✓				
FIRE RATING	3 HR	✓	✓			✓	✓		
	1½ HR			✓	✓			✓	✓
MOTORIZED	NO								
	YES	✓	✓	✓	✓	✓	✓	✓	✓
ROUND SPIGOTS	WITH		✓		✓		✓		✓
	WITHOUT	✓		✓		✓		✓	
TEMPERATURE RESPONSIVE DEVICE	"165°F RESETTABLE THERMOELECTRIC TRD"	✓	✓	✓	✓	✓	✓	✓	✓
ACTUATOR	HONEYWELL 3.4Nm					✓	✓	✓	✓
	HONEYWELL 9Nm	✓	✓	✓	✓				
	BELIMO 20Nm	✓	✓	✓	✓				
SLEEVE	WITH	✓	✓	✓	✓	✓	✓	✓	✓
	WITHOUT	ABOVE MODELS WITHOUT ROUND SPIGOT CAN BE WITHOUT SLEEVE & WITH ONE SIDE PLATE WHEN THE MODEL ENDS BY "-XS"							



Models BMFSD/R, BEMFSD/R, BMFSDLT/R & BEMFSDLT/R

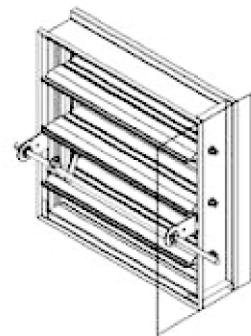

Models BMFSD-XS, BEMFSD-XS, BMFSDLT-XS & BEMFSDLT-XS









COMBINATION FIRE/SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F





MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)

ASSEMBLY

Single section assembly
up to 36"X36" (915X915mm)

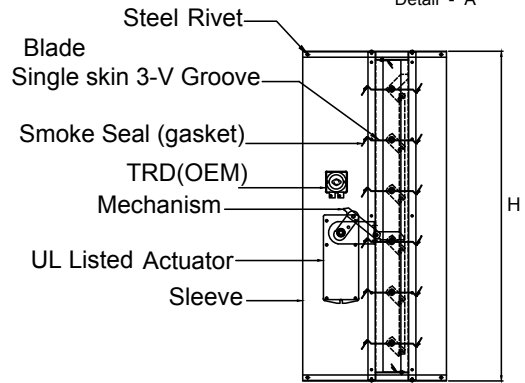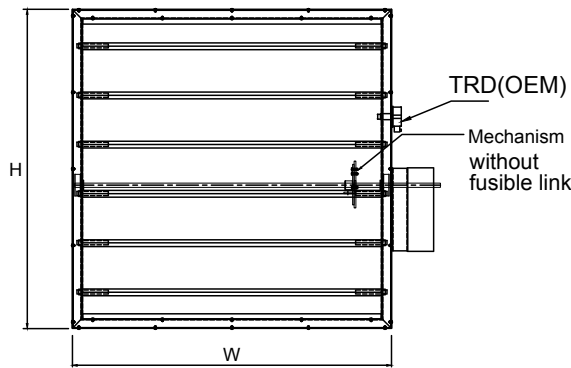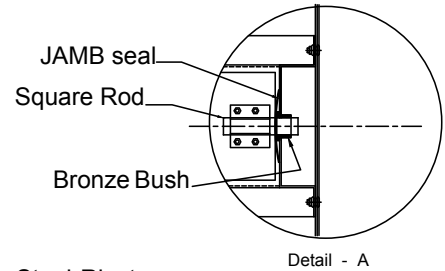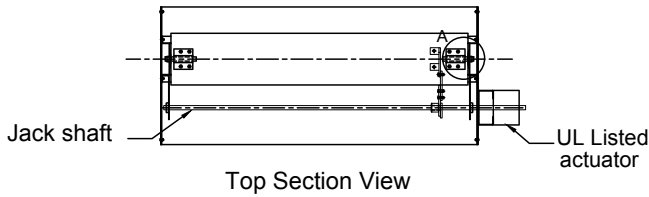

Multiple section assembly
up to 72"X72" (1830X1830mm)

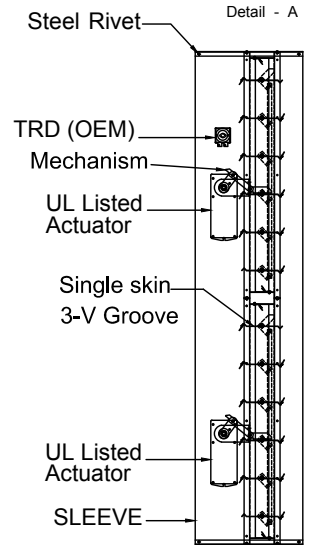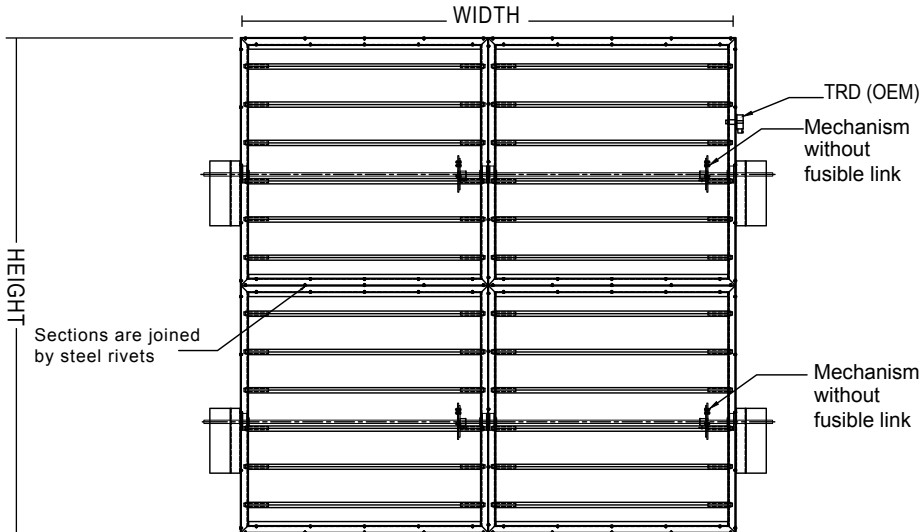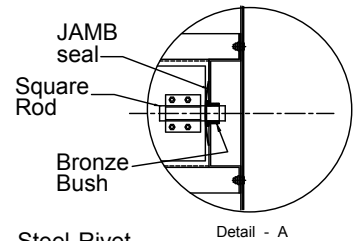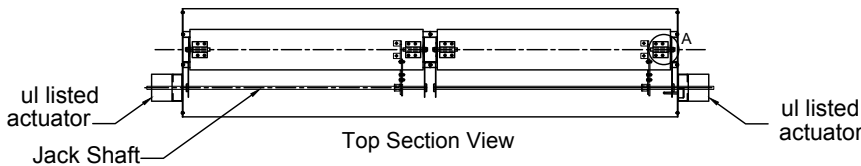




COMBINATION FIRE/SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)

PERFORMANCE DATA

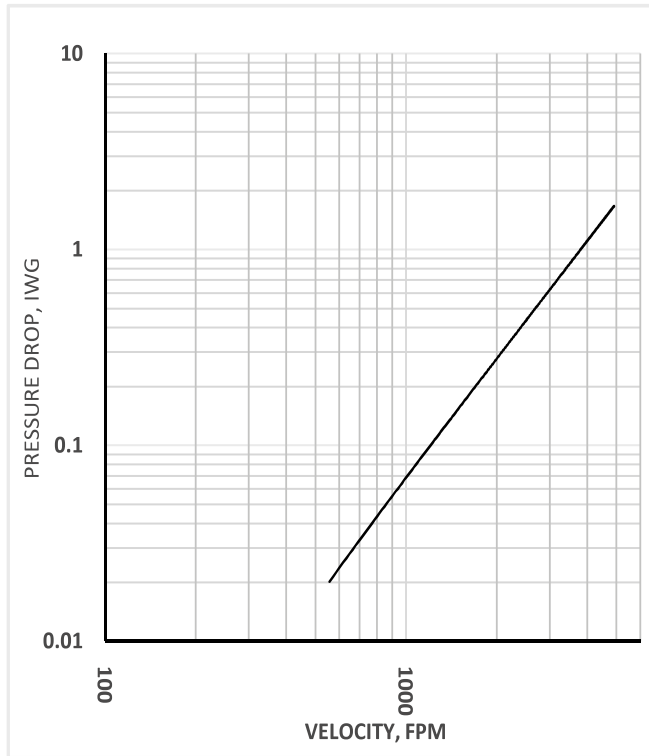

Note:
Pressure drop test was done at an independent laboratory in accordance with the AMCA 500-D standard on 36"X36" sample.

ORDERING KEY



B	MFSD	/Rd	-T	SIZE	XS
<p>B: 3 HRS RATED BE: 1½ HRS RATED</p>					
<p>-- MFSD - MOTORIZED COMBINED FIRE & SMOKE DAMPER WITH 9Nm ACTUATOR -- MFSDLT - MOTORIZED COMBINED FIRE & SMOKE DAMPER WITH 3.4Nm ACTUATOR --: WITHOUT ROUND SPIGOT /Rd: WITH ROUND SPIGOTS OF "d" DIA. ("d" IS DIAMETER IN INCH UP TO 32")</p>					
<p>-T: WITH RESETTABLE THERMOELECTRIC 165°F TEMPERATURE RESPONSIVE DEVICE (TRD)</p>					
<p>SIZE: WIDTH X HEIGHT --MFSD - SINGLE SECTION: MAX. 36" X 36" MULTIPLE SECTION: MAX. 72" X 72" --MFSDLT - SINGLE SECTION: MAX. 20" X 20"</p>					
<p>--: WITH SLEEVE (STANDARD) XS: WITHOUT SLEEVE</p>					





COMBINATION FIRE/SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)

INSTALLATION

(E)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMFSD-T, BMFSDLT-T, BEMFSD-T, BEMFSDLT-T, BMFSD/R-T, BMFSDLT/R-T, BEMFSD/R-T & BEMFSDLT/R-T

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 1).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90 mm from the wall and total depth of the sleeve should not exceed more than 510 mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30mm maximum from the corners. Retaining angles will be send in loose parts.
Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5 mm GI.
- 7) Push the re-set button to reset the TRD 165°F.
- 8) The duct-sleeve connection to be of as per listed in UL 555s .
Connecting ducts shall not be continuous and shall terminate at the sleeve.
Installation shall comply with NFPA 90A.
- 9) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

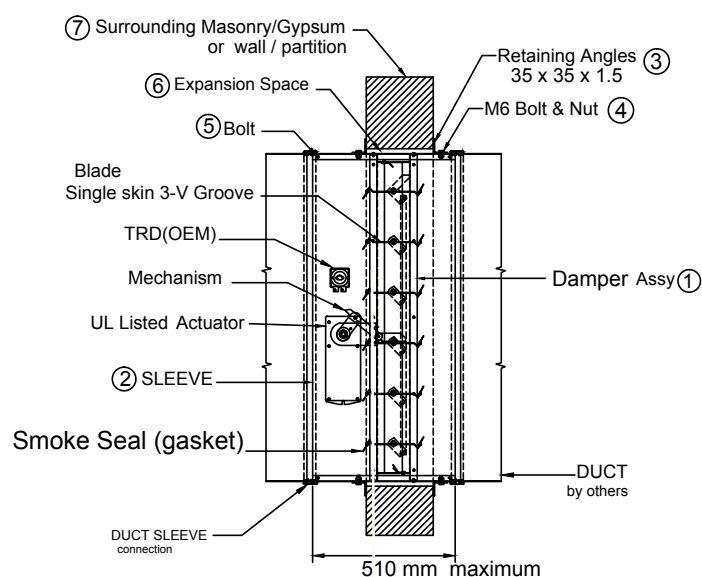


FIGURE 1






COMBINATION FIRE/SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F
 MODEL BMFSD (3 HR) / MODEL BEMFSD (1½ HR)

INSTALLATION

EXPLODED ASSEMBLY WITH SLEEVE:

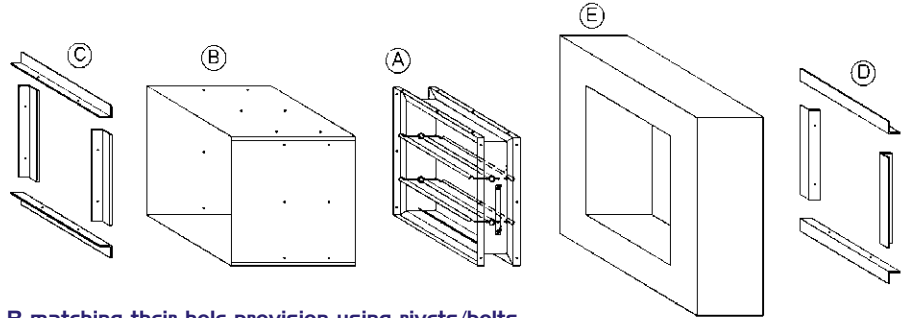


ASSEMBLY PROCEDURES:

- 1- Fix the damper A into the sleeve B matching their hole provision using rivets/bolts.
- 2- Fix the damper with sleeve into the concrete/gypsum wall opening E using the front retaining angle C 35X35 and matching their hole provision using M6 Hex bolt & nut. The sleeve B must overhang by a minimum of 90mm and maximum of 152mm. Opening size should have clearance of 3mm per 305mm of width and height.
- 3- Finally, when the subassembly is already fitted to the wall, fix the back retaining angle D 35X35 using M6 Hex bolt & nut.


DUCT-SLEEVE CONNECTIONS

FLANGED BREAKWAY CONNECTIONS:

TDC AND TDF ROLL-FORMED 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS, METAL CLEATS AND FOUR 9.5 mm METAL NUTS AND BOLTS.

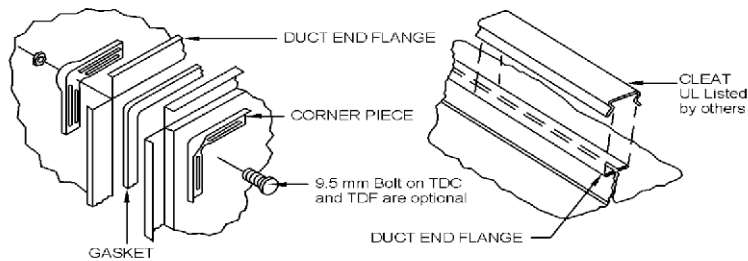


MANUFACTURED SLIP ON 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS AND PLASTIC CLEATS AS SHOWN BELOW.

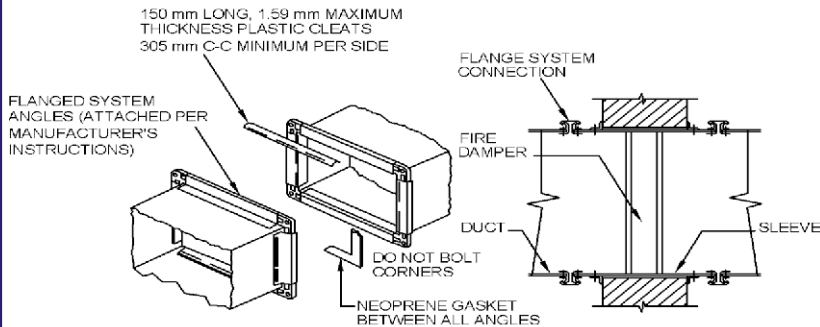

(UL TESTED CONNECTIONS BY OTHERS)

TRANSVERSE JOINTS BREAKWAY CONNECTIONS (WITHOUT FLANGES):

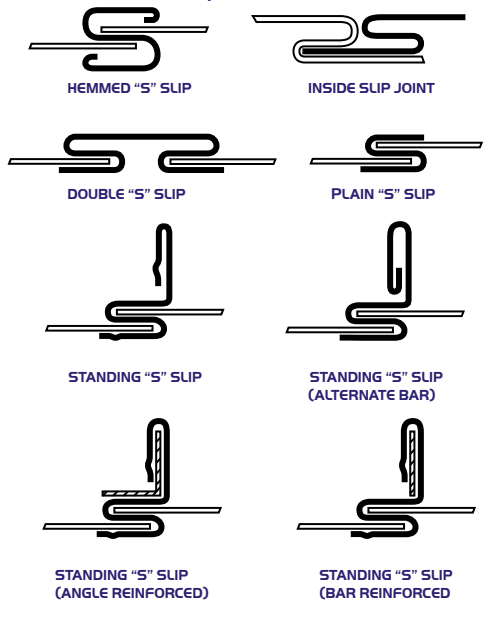

R21930





SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMSD / MODEL BMSDLT

STANDARD CONSTRUCTION

Standards: Designed and tested in accordance with UL555S. Meets NFPA 90A and SMACNA requirements for fire & smoke dampers.

Application: For dynamic smoke management systems.

Frame: 133mm Roll formed hat-shaped made of 1.4mm thick galvanized steel with reinforced corners, having integral bracing and 90° perpendicular overlap at a corner.

Blades: Roll formed 3 V-shaped made of 1.4mm thick galvanized steel.

Bushes: Bronze bushes.

Axles: 3/8" Square axles made of galvanized steel.

Linkage: Mechanical and concealed in frame.

Drive Mechanism: 1/2" Round Jack Shaft made of galvanized steel.

Jamb Seals: Stainless steel jamb seals.



Model BMSD & BMSDLT

Blades Seals: UL listed high-temperature (exceeding 450° F) Silicone blades edges seal/gasket manufactured in accordance with UL555S requirements.

Actuators: A UL listed HONEYWELL 3.4 Nm actuator for each single section damper up to 20"X20"
A UL listed HONEYWELL 9 Nm actuator for each single section damper up to 36"X36".
A UL listed BELIMO 20Nm actuator for each single section damper up to 36"X36"

Sleeve: Sleeve made of 400mm depth and 1.1mm thickness galvanized steel.

Mounting: Vertical/Horizontal mounting.

Air Flow Rating: 2000 FPM / 4 IWG.

Leakage: Class I @ 350°F
Class I @ 250°F
Class 2 @ 250°F

Sizes: Single Section: Max. 36" X 36"
Multiple Section: Max. 72" X 72"





SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F
 MODEL BMSD / MODEL BMSDLT

OPTIONS

- Without Sleeve. With one side plate only (Model BMSD-XS & BMSDLT-XS).
- Round spigots for model BMSD/R & BMSDLT/R.

FEATURE	MODEL	BMSD	BMSD/R	BMSDLT	BMSDLT/R
USE	FIRE BARRIER				
	SMOKE BARRIER	✓	✓	✓	✓
SYSTEM	STATIC				
	DYNAMIC	✓	✓	✓	✓
AIR FLOW RATING	2000 FPM	✓	✓	✓	✓
PRESSURE RATING	4 IWG	✓	✓	✓	✓
LEAKAGE CLASS	CLASS I - 250°F	✓	✓	✓	✓
	CLASS I - 350°F	✓	✓		
	CLASS 2 - 250°F	✓	✓		
FIRE RATING	3 HR				
	1½ HR				
MOTORIZED	NO				
	YES	✓	✓	✓	✓
ROUND SPIGOTS	WITH		✓		✓
	WITHOUT	✓		✓	
TEMPERATURE RESPONSIVE DEVICE	"165°F RESETTABLE THERMOELECTRIC TRD"				
ACTUATORS	HONEYWELL 3.4Nm			✓	✓
	HONEYWELL 9Nm	✓	✓		
	BELIMO 20NM	✓	✓		
SLEEVE	WITH	✓	✓	✓	✓
	WITHOUT	ABOVE MODELS WITHOUT ROUND SPIGOT CAN BE WITHOUT SLEEVE & WITH ONE SIDE PLATE WHEN THE MODEL ENDS BY "-XS"			



Model BMSD/R & BMSDLT/R



Model BMSD-XS & BMSDLT-XS









SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F





MODEL BMSD / MODEL BMSDLT

ASSEMBLY

Single section assembly
up to 36"X36" (915X915mm)

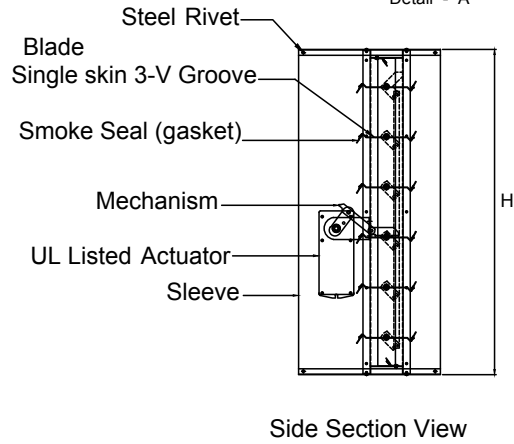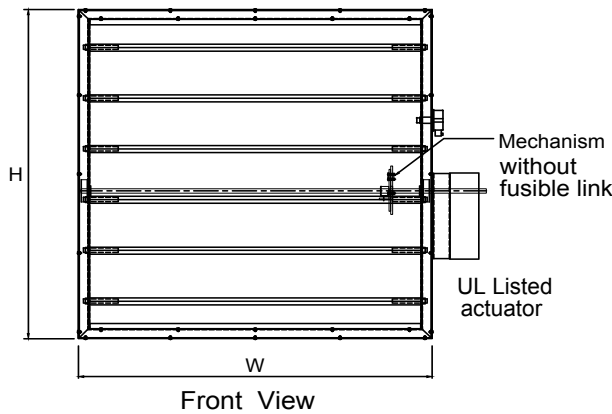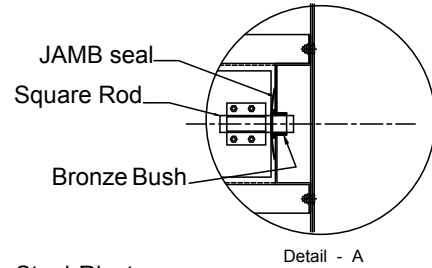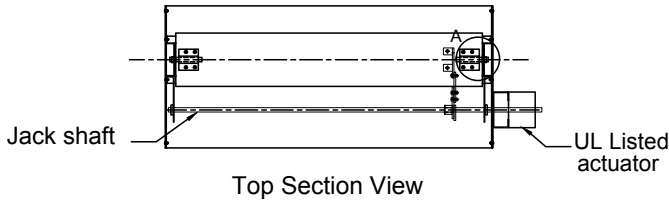

Multiple section assembly
up to 72"X72" (1830X1830mm)

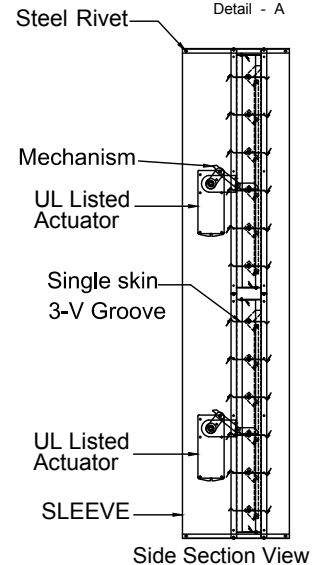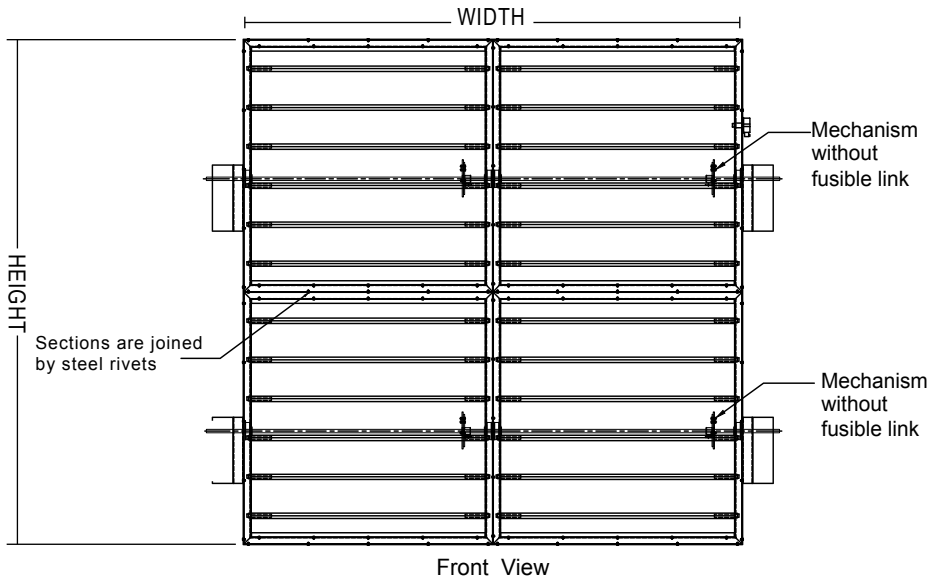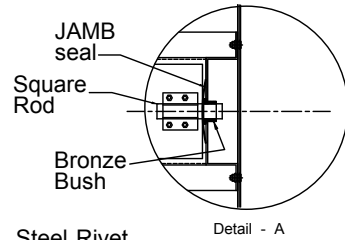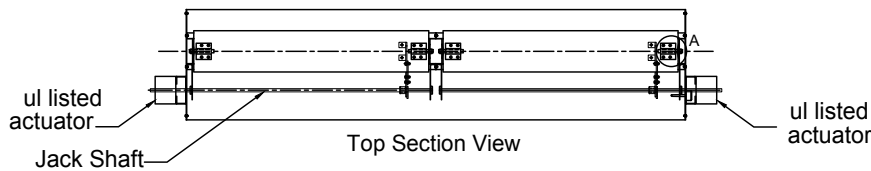




SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F
 MODEL BMSD / MODEL BMSDLT

PERFORMANCE DATA

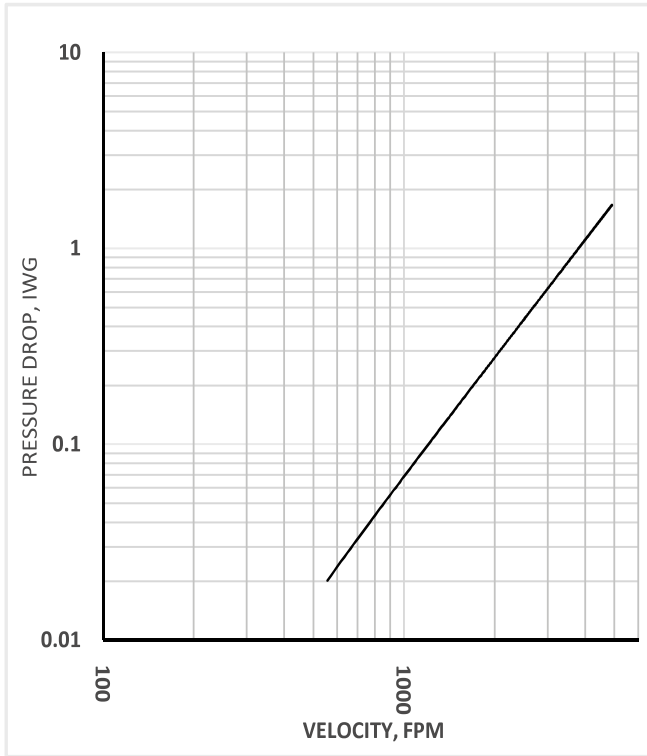

Note:
 Pressure drop test was done at an independent laboratory in accordance with the AMCA 500-D standard on 36"X36" sample.



ORDERING KEY

BMSD	/R8	SIZE	XS
--MSD - MOTORIZED SMOKE DAMPER WITH 9Nm ACTUATOR --MSDLT - MOTORIZED SMOKE DAMPER WITH 3.4Nm ACTUATOR --: WITHOUT ROUND SPIGOT /Rd: WITH ROUND SPIGOTS OF "d" DIA. ("d" IS DIAMETER IN INCH UP TO 32") SIZE: WIDTH X HEIGHT --MSD - SINGLE SECTION: MAX. 36" X 36" MULTIPLE SECTION: MAX. 72" X 72" --MSDLT - SINGLE SECTION: MAX. 20" X 20" --: WITH SLEEVE (STANDARD) XS: WITHOUT SLEEVE			





SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMSD / MODEL BMSDLT

INSTALLATION

(F)

INSTALLATION AND OPERATING INSTRUCTIONS FOR MODELS BMSD, BMSDLT, BMSD/R & BMSDLT/R

- 1) The damper (1) should be installed vertical, centrally and resting on the bottom opening within the surrounding masonry / gypsum wall (7). Actuator should be out of wall / gypsum partition as shown in (figure 1).
- 2) The damper (1) should be installed in a rectangular galvanized steel sleeve (2) with a minimum thickness of 1.1mm. This sleeve should be attached to the damper using M6 bolts (5) and spaced at not more than 110 mm centers and 30 mm from corners.
- 3) Clearance requirements for damper sleeves within a wall opening are based on 1/8 inch per foot (10mm per meter) of width or height unless otherwise stated in the listing of the assembly.
- 4) The sleeve (2) should be of suitable length to extend through the wall to enable the fitting of the cover angles and ductwork. Minimum of 90 mm from the wall and total depth of the sleeve should not exceed more than 510 mm.
- 5) The retaining angles (3) should be attached to the sleeve by 6 mm dia (4) bolts at a maximum of 110 mm centers, and should form a complete frame around the sleeve and cover over the expansion space (6) required between sleeve and wall opening. The four corner of the retaining angles are not to be welded. The bolts connecting the retaining angles to the sleeve to be 30 mm maximum from the corners. Retaining angles will be send in loose parts.
Note: The retaining angles bolts should be out of the area of the damper frame.
- 6) The retaining angles (3) should be of such a size as always to form an overlap with the wall by 25mm minimum and should be manufactured from a minimum size of 35 x 35 x 1.5 mm GI.
- 7) The duct-sleeve connection to be of as per listed in UL 555s. Connecting ducts shall not be continuous and shall terminate at the sleeve. Installation shall comply with NFPA 90A.
- 8) All fixing of frames must be positioned clear of the damper blade path so as not to impede proper closure.

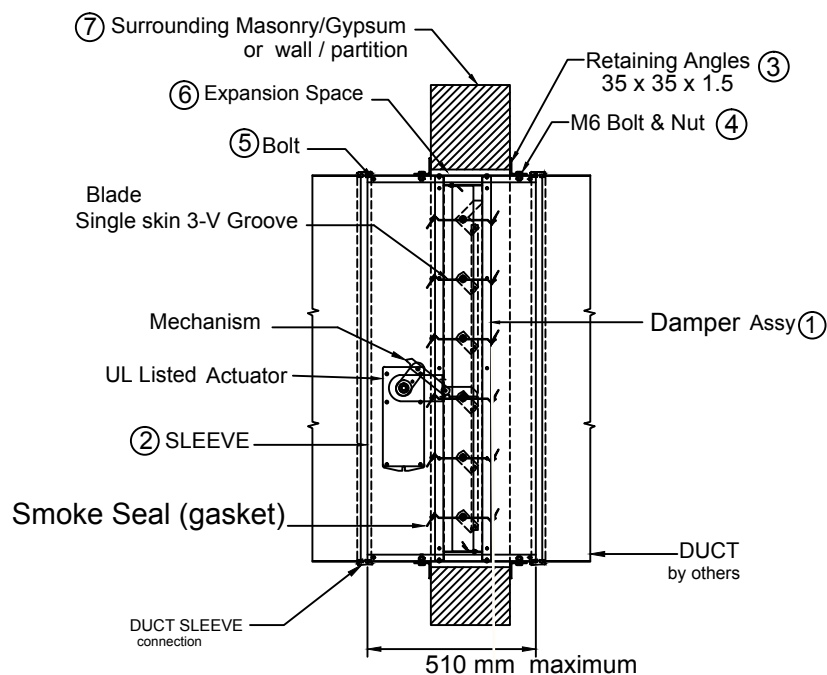


FIGURE 1






SMOKE DAMPER

CLASS I - 350°F - CLASS I - 250°F - CLASS 2 - 250°F

MODEL BMSD / MODEL BMSDLT

INSTALLATION

EXPLODED ASSEMBLY WITH SLEEVE:

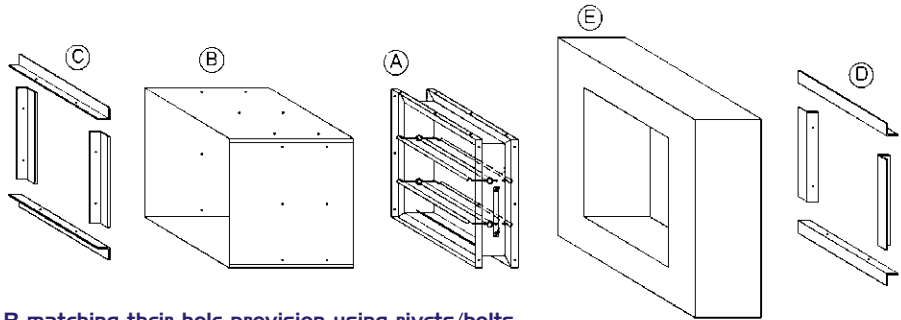


ASSEMBLY PROCEDURES:

- 1- Fix the damper A into the sleeve B matching their hole provision using rivets/bolts.
- 2- Fix the damper with sleeve into the concrete/gypsum wall opening E using the front retaining angle C 35X35 and matching their hole provision using M6 Hex bolt & nut. The sleeve B must overhang by a minimum of 90mm and maximum of 152mm. Opening size should have clearance of 3mm per 305mm of width and height.
- 3- Finally, when the subassembly is already fitted to the wall, fix the back retaining angle D 35X35 using M6 Hex bolt & nut.


DUCT-SLEEVE CONNECTIONS

FLANGED BREAKWAY CONNECTIONS:

TDC AND TDF ROLL-FORMED 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS, METAL CLEATS AND FOUR 9.5 mm METAL NUTS AND BOLTS.

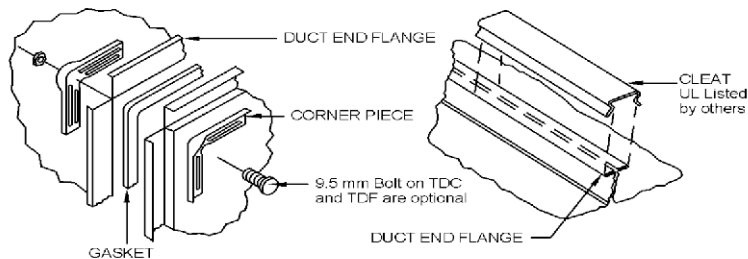


MANUFACTURED SLIP ON 4-BOLT FLANGED CONNECTIONS ASSEMBLED PER THE MANUFACTURER'S INSTRUCTIONS USING GASKETS AND PLASTIC CLEATS AS SHOWN BELOW.

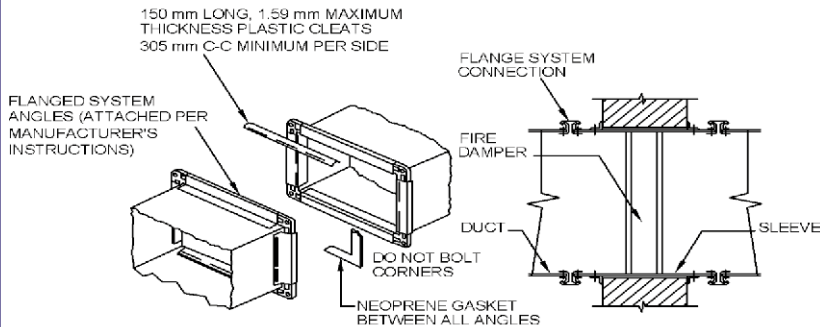

(UL TESTED CONNECTIONS BY OTHERS)

TRANSVERSE JOINTS BREAKWAY CONNECTIONS (WITHOUT FLANGES):

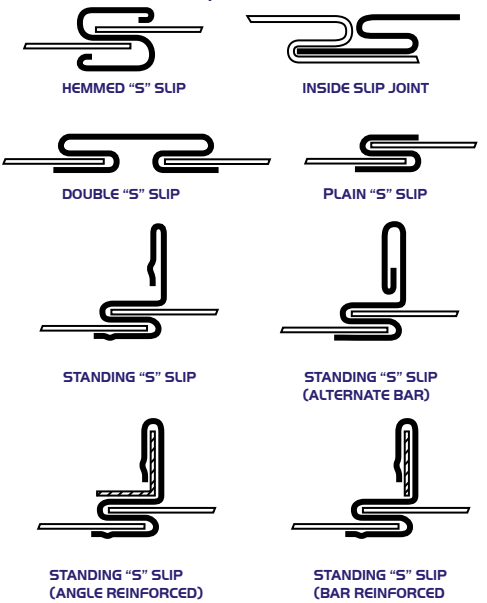

R21930





BETA

industrial

Dubai Head Office:
Tel: +971 4 706 9777
Fax: +971 4 706 9787

Abu Dhabi Branch:
Tel: +971 2 645 0107
Fax: +971 2 645 0167

Saudi Arabia:
Tel: +966 1 265 4551
Fax: +966 1 265 4550

Email: betai@betag.com
P.O.Box 50708, Dubai
United Arab Emirates

www.betag.com

